


MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

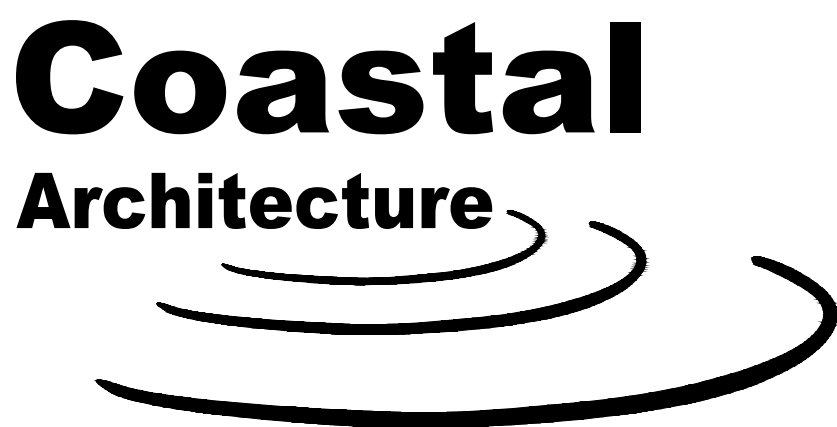

Coastal Architecture, DRAWINGS, SPECIFICATIONS AND OTHER DOCUMENTS

The Drawings, Specifications and other documents prepared by Coastal Architecture, the Designer, for this project are instruments of service for use solely with respect to this project and, unless otherwise provided, the Designer shall be deemed the author of these documents and shall retain all common law, statutory and other reserved rights, including copyright protection. The Owner shall be permitted to retain copies of the Designer's drawings, Specifications, and other documents for information and reference in connection with the Owner's use and occupancy of this project. No portions in part or in whole of the Drawings, Specifications and other documents shall be duplicated or used by the Owner or others for additions to this Project, completion of this Project by others, or on other Projects without written consent by the Designer.

DRAWING LIST

CS-1	COVER SHEET
G-1	GENERAL DATA
G-2	LIFE SAFETY PLAN
EX-1	EXISTING FLOOR PLAN
EX-2	EXISTING ELEVATIONS
D-1	DEMO PLAN
A-1	NEW FLOOR PLAN
A-1.1	NEW ROOF PLAN
A-2	REFLECTED CEILING PLAN
A-3	SCHEDULES
A-4	EXTERIOR ELEVATIONS
A-5	WALL SECTIONS
A-5.1	WALL SECTIONS
A-6	ENLARGED PLANS, INTERIOR ELEVATIONS
A-7	NOT USED
A-8	DETAILS
P-1	PLUMBING SPECIFICATIONS
P-2	PLUMBING DEMO PLAN
P-3	DWY PLAN
P-4	SUPPLY PLAN
M-1	HVAC SCHEDULES
M-2	HVAC DEMO PLAN
M-3	REVISED HVAC PLAN
M-4	HVAC SPECS AND DETAILS
E-1	ELECTRICAL SPECIFICATIONS
E-2	EXISTING LIGHTING PLAN
E-3	NEW LIGHTING PLAN
E-4	NEW POWER PLAN
E-5	ELECTRICAL PANEL 4 RISER

Coastal
Architecture

• Architectural
Design

• Planning

• Interiors

AIA


Member of the American
Institute of Architects

Lee D. Dixon, Jr., AIA
252-247-2121
lee@coastalarchitecture.net

4206 Bridges St. Ext.,
Suite C
Morehead City, NC
28557

www.CoastalArchitecture.net

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

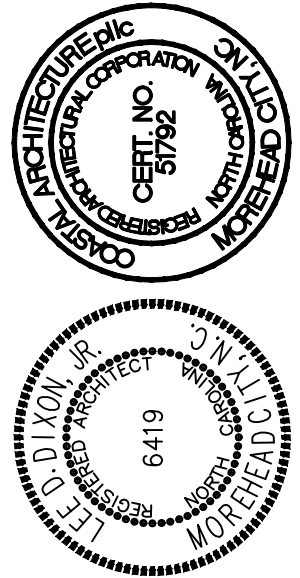

COVER SHEET

17038

ISSUED: 28 NOV 18
DWG BY: MES
CKD BY: LDD

REVISIONS	

SHEET NO.
CS-1
OF

STRUCTURAL DESIGN

DESIGN LOADS:

Importance Factors: Wind (I_w) _____
 Snow (I_s) _____
 Seismic (I_e) _____

Live Loads: Roof _____ psf
 Mezzanine _____ psf
 Floor _____ psf

Ground Snow Load: _____ psf

Wind Load: Basic Wind Speed _____ mph (ASCE 7-02)
 Exposure Category _____
 Wind Base Shear (for MWFRS) $V_x =$ _____ $V_y =$ _____

SEISMIC DESIGN CATEGORY ☐ A ☐ B ☐ C ☐ D

Provide the following Seismic Design Parameters:

Occupancy Category ☐ I ☐ II ☐ III ☐ IV _____

Spectral Response Reduction S_s _____ %g S_1 _____ %g

Seismic Definition (Table 1613.5.2) ☐ A ☐ B ☐ C ☐ D

_____ Data Source: ☐ Field Test ☐ Presumptive ☐ Historical Data

Basic structural system (check one)

☐ Bearing Wall ☐ Dual w/Special Moment Frame
☐ Building Frame ☐ Dual w/ Intermediate R/C or Special Steel
☐ Moment Frame ☐ Inverted Pendulum

Seismic base shear $V_x =$ _____ $V_y =$ _____

Analysis Procedure ☐ Simplified ☐ Equivalent Lateral Force ☐ Dynamic

Architectural, Mechanical, Components anchored? ☐ Yes ☐ No

LATERAL DESIGN CONTROL: Earthquake ☐ Wind ☐

SOIL BEARING CAPACITIES:

Field Test (provide copy of test report) _____ psf
 Presumptive Bearing capacity _____ psf
 Pile size, type, and capacity _____

PLUMBING FIXTURE REQUIREMENTS
 (TABLE 2902.1)

USE	WATERCLOSETS		URINALS	LAVATORIES		SHOWERS/ TUBS	DRINKING FOUNTAINS	
	MALE	FEMALE		MALE	FEMALE		REGULAR	ACCESSIBLE
BUSINESS	EXISTING							
	NEW	1	1	N/A	1	1		1
	REQUIRED	1	1	N/A	1	1		1
STORAGE	EXISTING							
	NEW	1	N/A	1	1	N/A	N/A	N/A
	REQUIRED	1	N/A	1	1	N/A	N/A	N/A

SPECIAL APPROVALS	
Special approval: (Local Jurisdiction, Department of Insurance, OSC, DPI, DHHS, ICC, etc., describe below)	
ENERGY SUMMARY	
ENERGY REQUIREMENTS: The following data shall be considered minimum and any special attribute required to meet the energy code shall also be provided. Each Designer shall furnish the required portions of the project information for the plan data sheet. If performance method, state the annual energy cost for the standard reference design vs annual energy cost for the proposed design.	
Climate Zone: ☐ 3A ☐ 4 ☐ 5	
Method of Compliance: ☐ Prescriptive (Energy Code) ☐ Performance (Energy Code) ☐ Prescriptive (ASHRAE 90.1) ☐ Performance (ASHRAE 90.1)	
THERMAL ENVELOPE	
Roof/Ceiling Assembly (each assembly)	
Description of assembly: _____	
U-Value of total assembly: _____	
R-Value of insulation: _____ EXISTING	
Skylights in each assembly: _____	
U-Value of skylight: _____	
total square footage of skylights in each assembly: _____	
Exterior Walls (each assembly)	
Description of assembly: _____ 6" Metal studs, Densglass and EIFS or ACM	
U-Value of total assembly: _____ R25	
R-Value of insulation: _____	
Openings (windows or doors with glazing)	
U-Value of assembly: _____ U29	
Solar heat gain coefficient: _____ U31	
projection factor: _____ U125	
Door R-Values: _____ U65	
Walls below grade (each assembly)	
Description of assembly: _____	
U-Value of total assembly: _____ N/A	
R-Value of insulation: _____	
Floors over unconditioned space (each assembly)	
Description of assembly: _____	
U-Value of total assembly: _____ N/A	
R-Value of insulation: _____	
Floors slab on grade	
Description of assembly: _____ Concrete Slab	
U-Value of total assembly: _____	
R-Value of insulation: _____	
Horizontal/Vertical requirement: _____	
slab heated: _____ N/A	

MECHANICAL SUMMARY

MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT

Thermal Zone

winter dry bulb: _____

summer dry bulb: _____

Interior design conditions

winter dry bulb: _____

summer dry bulb: _____

relative humidity: _____

Building heating load: _____

Building cooling load: _____

Mechanical Spacing Conditioning System

Unitary

description of unit: _____

heating efficiency: _____

cooling efficiency: _____

size category of unit: _____

Boiler

Size category. If oversized, state reason: _____

Chiller

Size category. If oversized, state reason: _____

List equipment efficiencies: _____



4'-0"

4'-0"

ARCHITECT: **Coastal**
Architecture

252.247.2127

www.coastalarchitecture.net

CONTRACTOR:

BLUE BORDER STRIFE

1/2" EXTERIOR GRADE PLYWOOD

WHITE BACKGROUND U.O.N.

BLUE LOGO

BLACK LETTERS U.O.N.

P.T. 6x6 POSTS SET IN GROUND 2'-6" WITH 2-2x6 BRACES

OF

THESE DRAWING AND SPECIFICATIONS REPRESENT AN INSTRUMENT OF SERVICE AND AS SUCH SHALL REMAIN IN OWNERSHIP WITH THE ARCHITECT. USE OR REPRODUCTION BY ANY MEANS, IN WHOLE OR IN PART, WITHOUT THE ARCHITECT'S WRITTEN CONSENT, IS PROHIBITED.



- Architectural Design
- Planning
- Interiors





Member of the American Institute of Architects

Lee D. Dixon, Jr., AIA
252-247-2121
lee@coastalarchitecture.net

4206 Bridges St. Ext., Suite C
Morehead City, NC 28557

www.CoastalArchitecture.net

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA



EXISTING FLOOR PLAN

17038

ISSUED: 28 NOV 18


DWG BY: LSA

CKD BY: LDD


REVISIONS

SHEET NO.


EX-1
OF

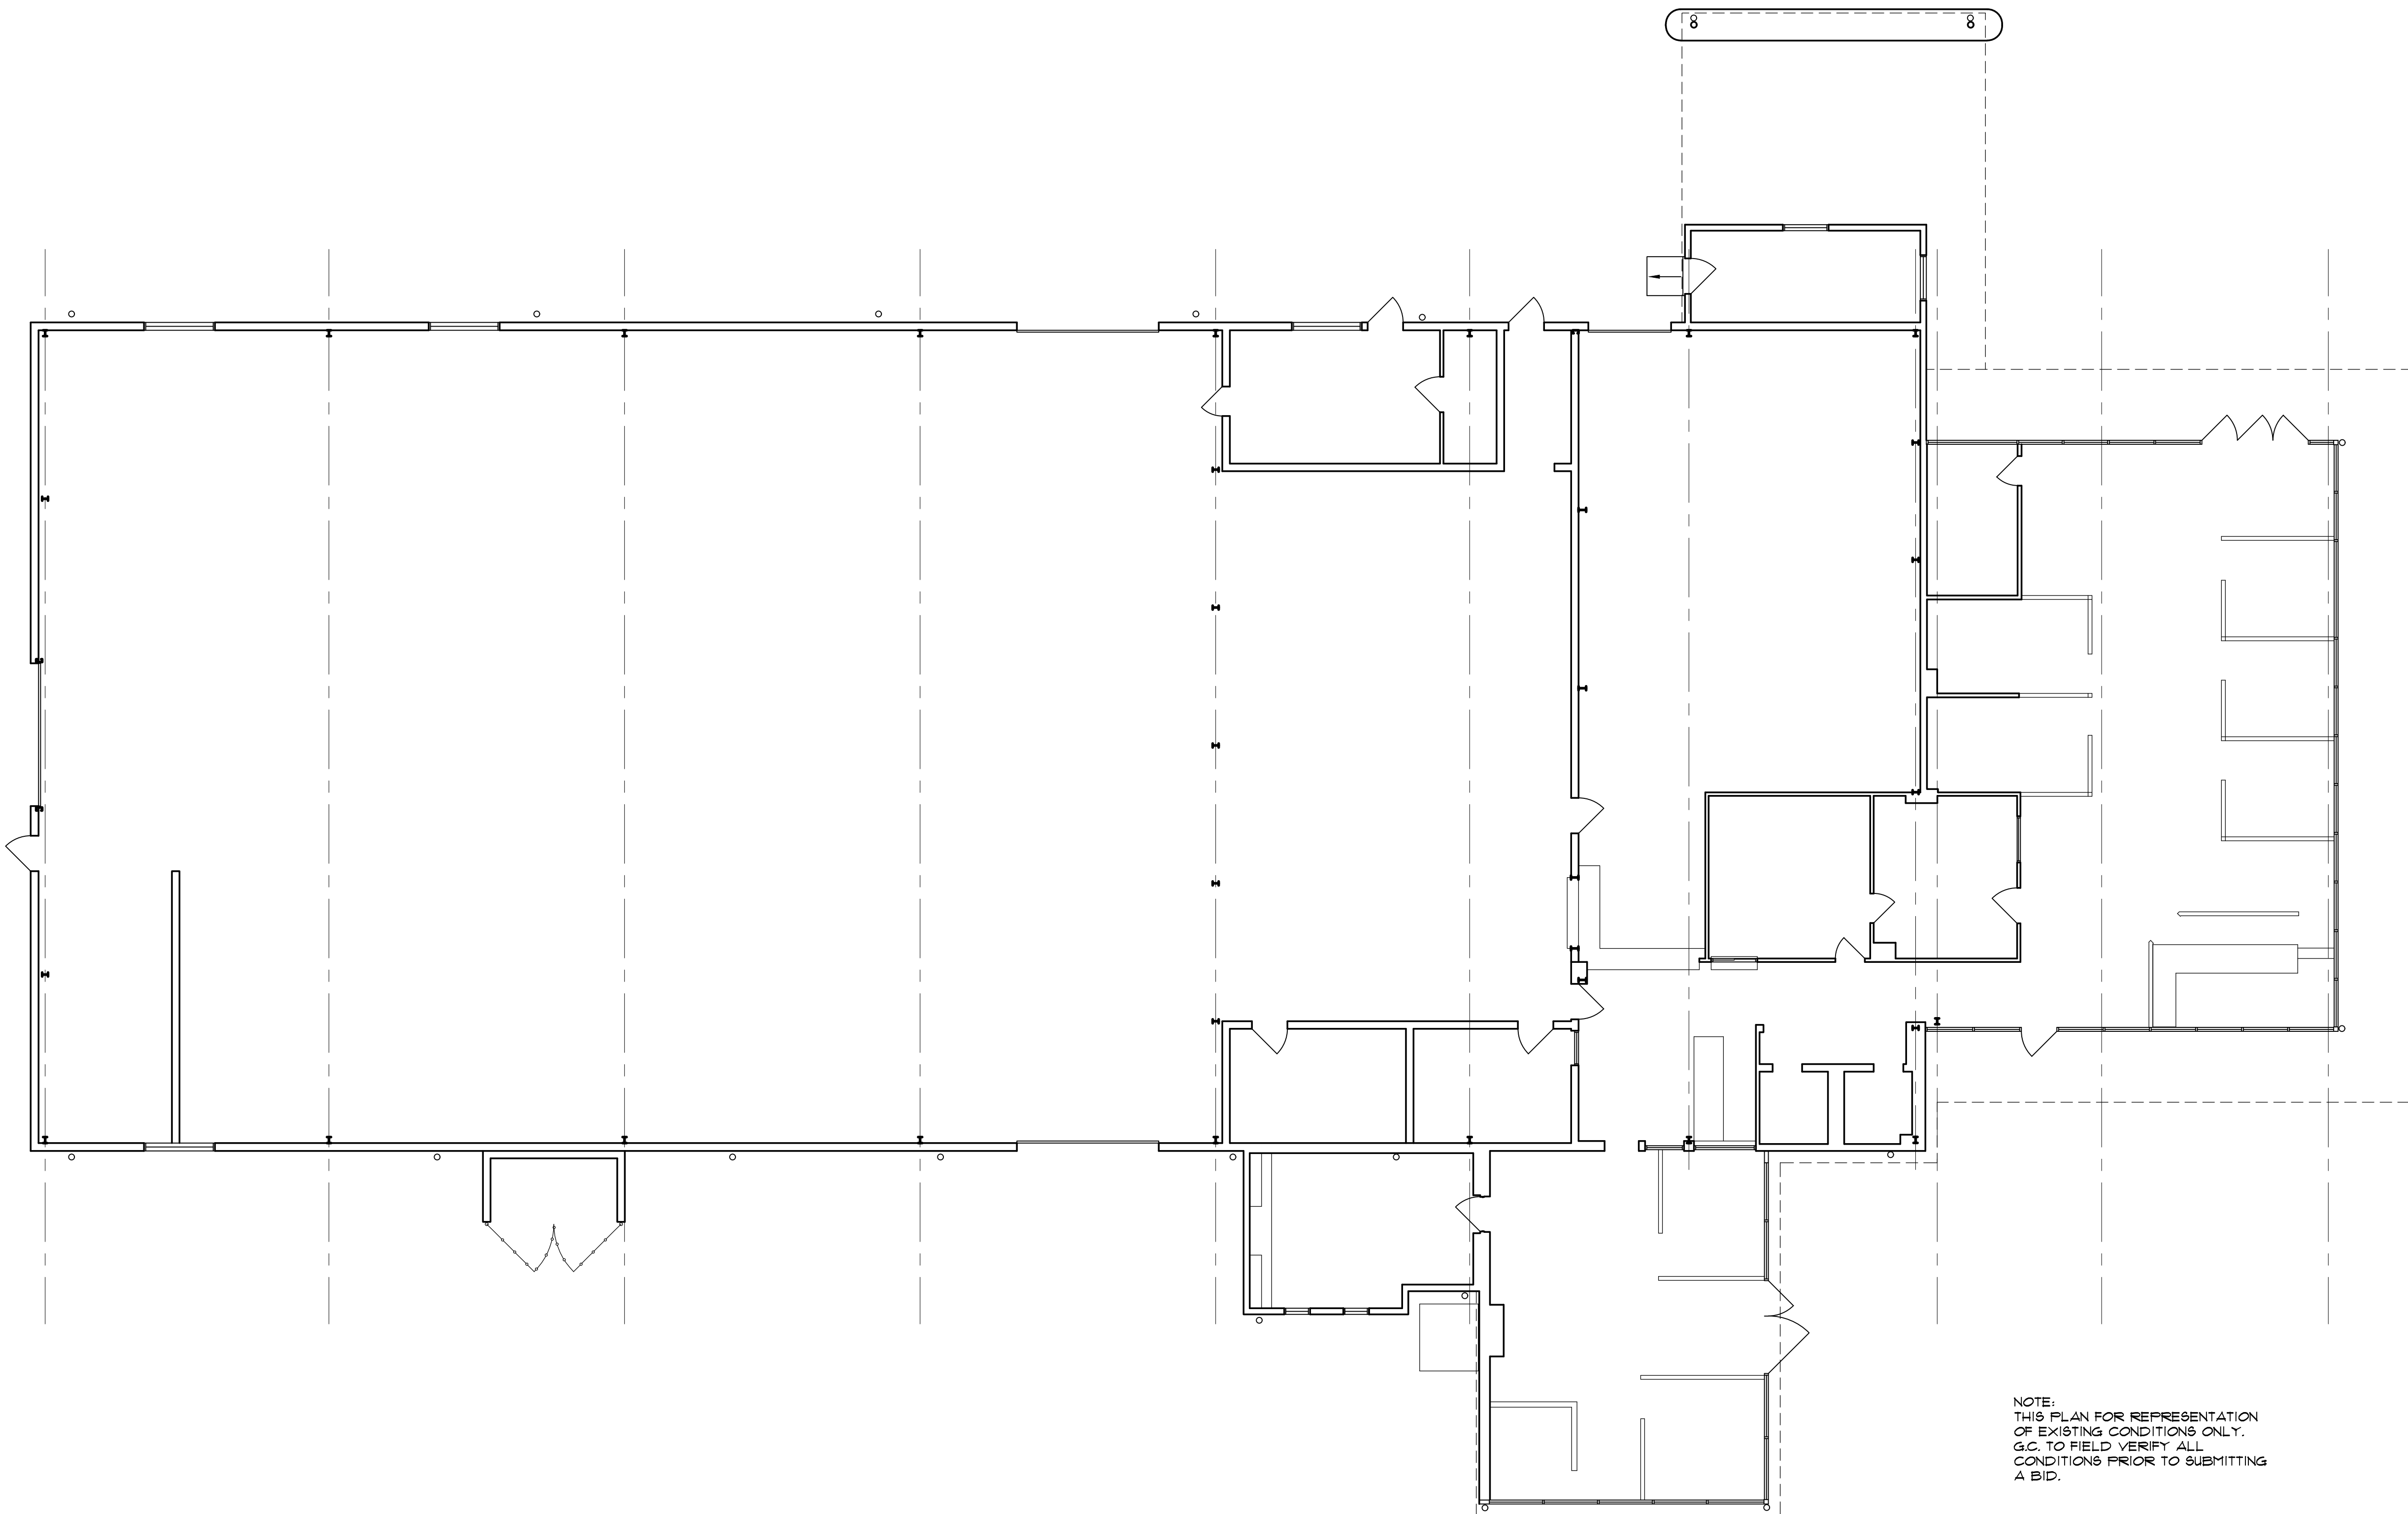


EXISTING FLOOR PLAN
EX-1 SCALE: 1/8" = 1'-0"

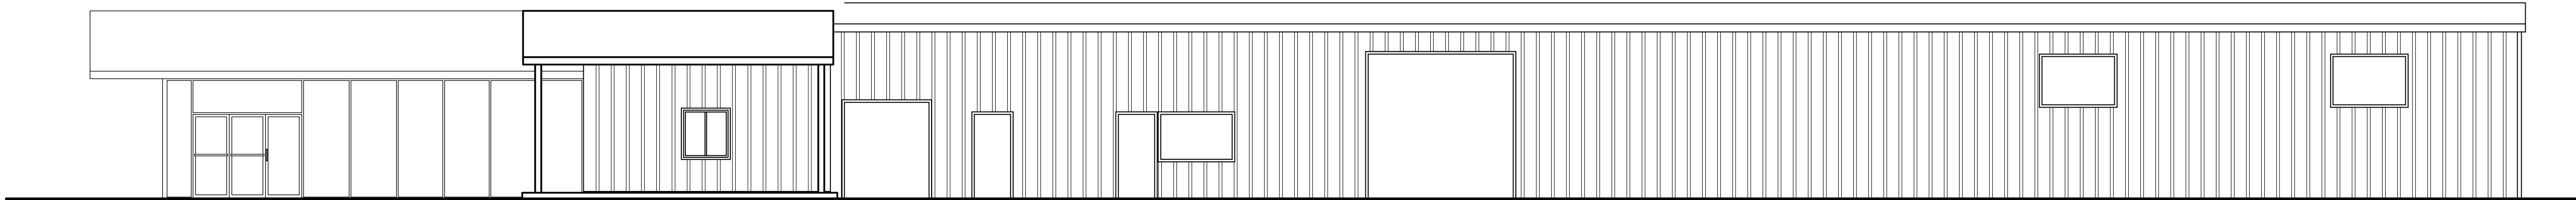


4 RIGHT ELEVATION
EX-2 SCALE: 1/8"=1'-0"

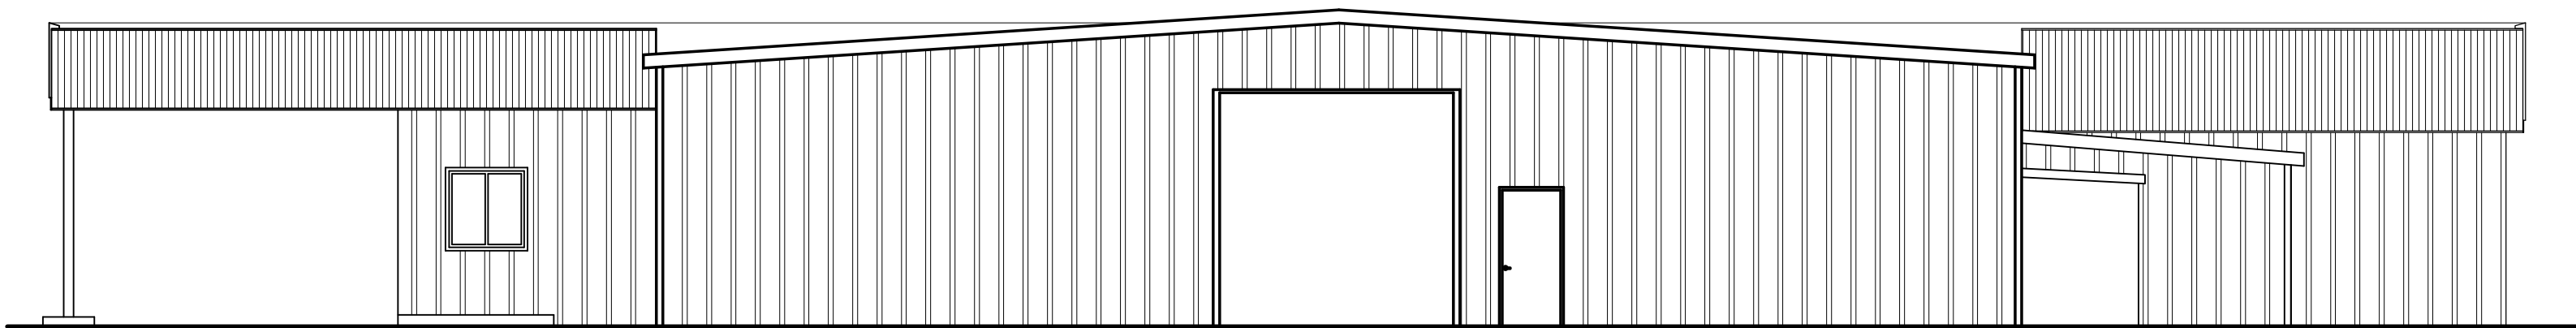

3 REAR ELEVATION
EX-2 SCALE: 1/8"=1'-0"

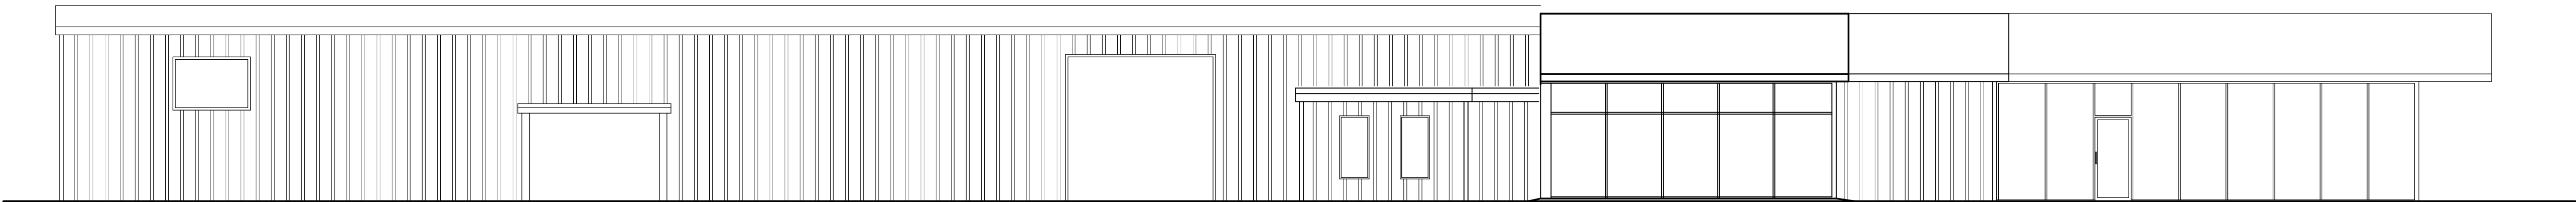

2 LEFT ELEVATION
EX-2 SCALE: 1/8"=1'-0"

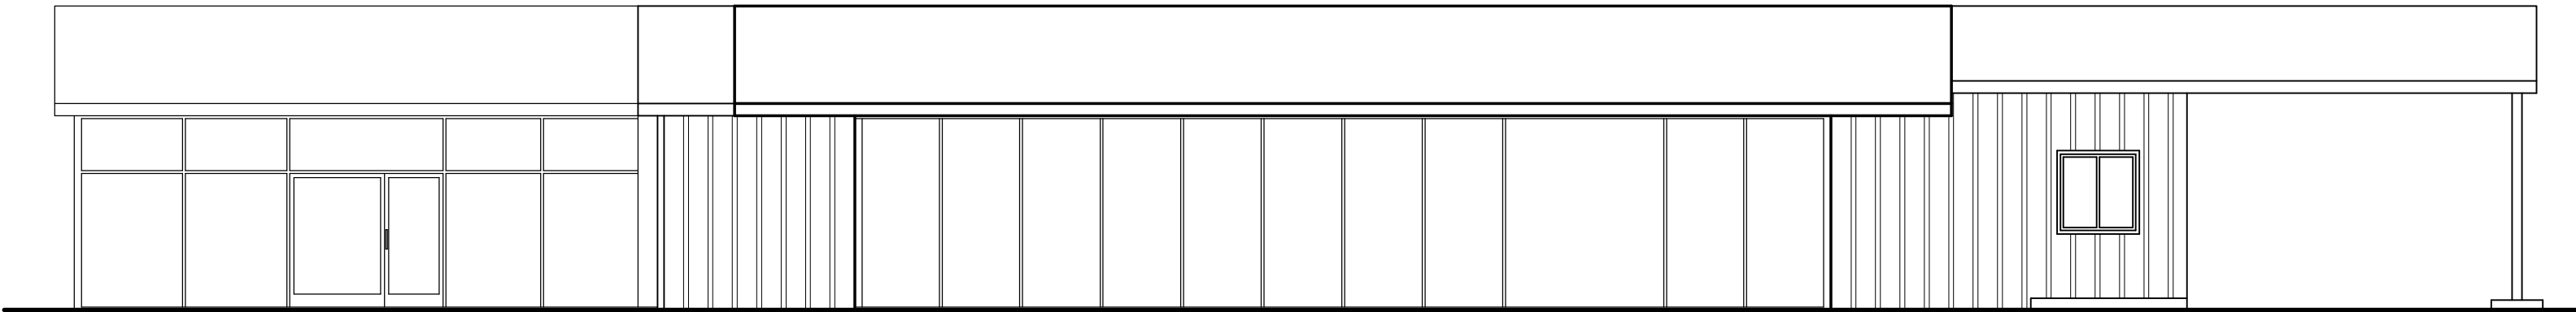

1 FRONT ELEVATION
EX-2 SCALE: 1/8"=1'-0"

NOTE:
THIS DRAWING IS FOR
REPRESENTATION OF EXISTING
CONDITIONS ONLY. G.C. TO FIELD
VERIFY ALL CONDITIONS PRIOR
TO SUBMITTING A BID.



- Architectural Design
- Planning
- Interiors





Member of the American
Institute of Architects

Lee D. Dixon, Jr., AIA
252-247-2121
lee@coastalarchitecture.net

4206 Bridges St. Ext.,
Suite C
Morehead City, NC
28557

www.CoastalArchitecture.net

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA



EXISTING
EXTERIOR
ELEVATIONS

17038

ISSUED: 28 NOV 18

DWG BY: LSA



CKD BY: LDD

REVISIONS

SHEET NO.

EX-2
OF

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

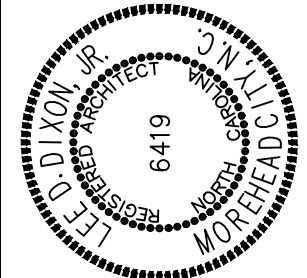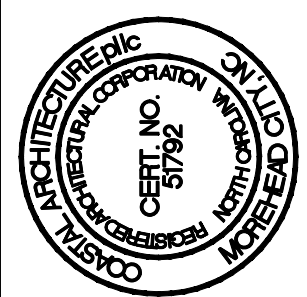

DEMO PLAN

17038

ISSUED: 28 NOV 18


DWG BY: LSA

CKD BY: LDD

REVISIONS

SHEET NO.

D-1
OF

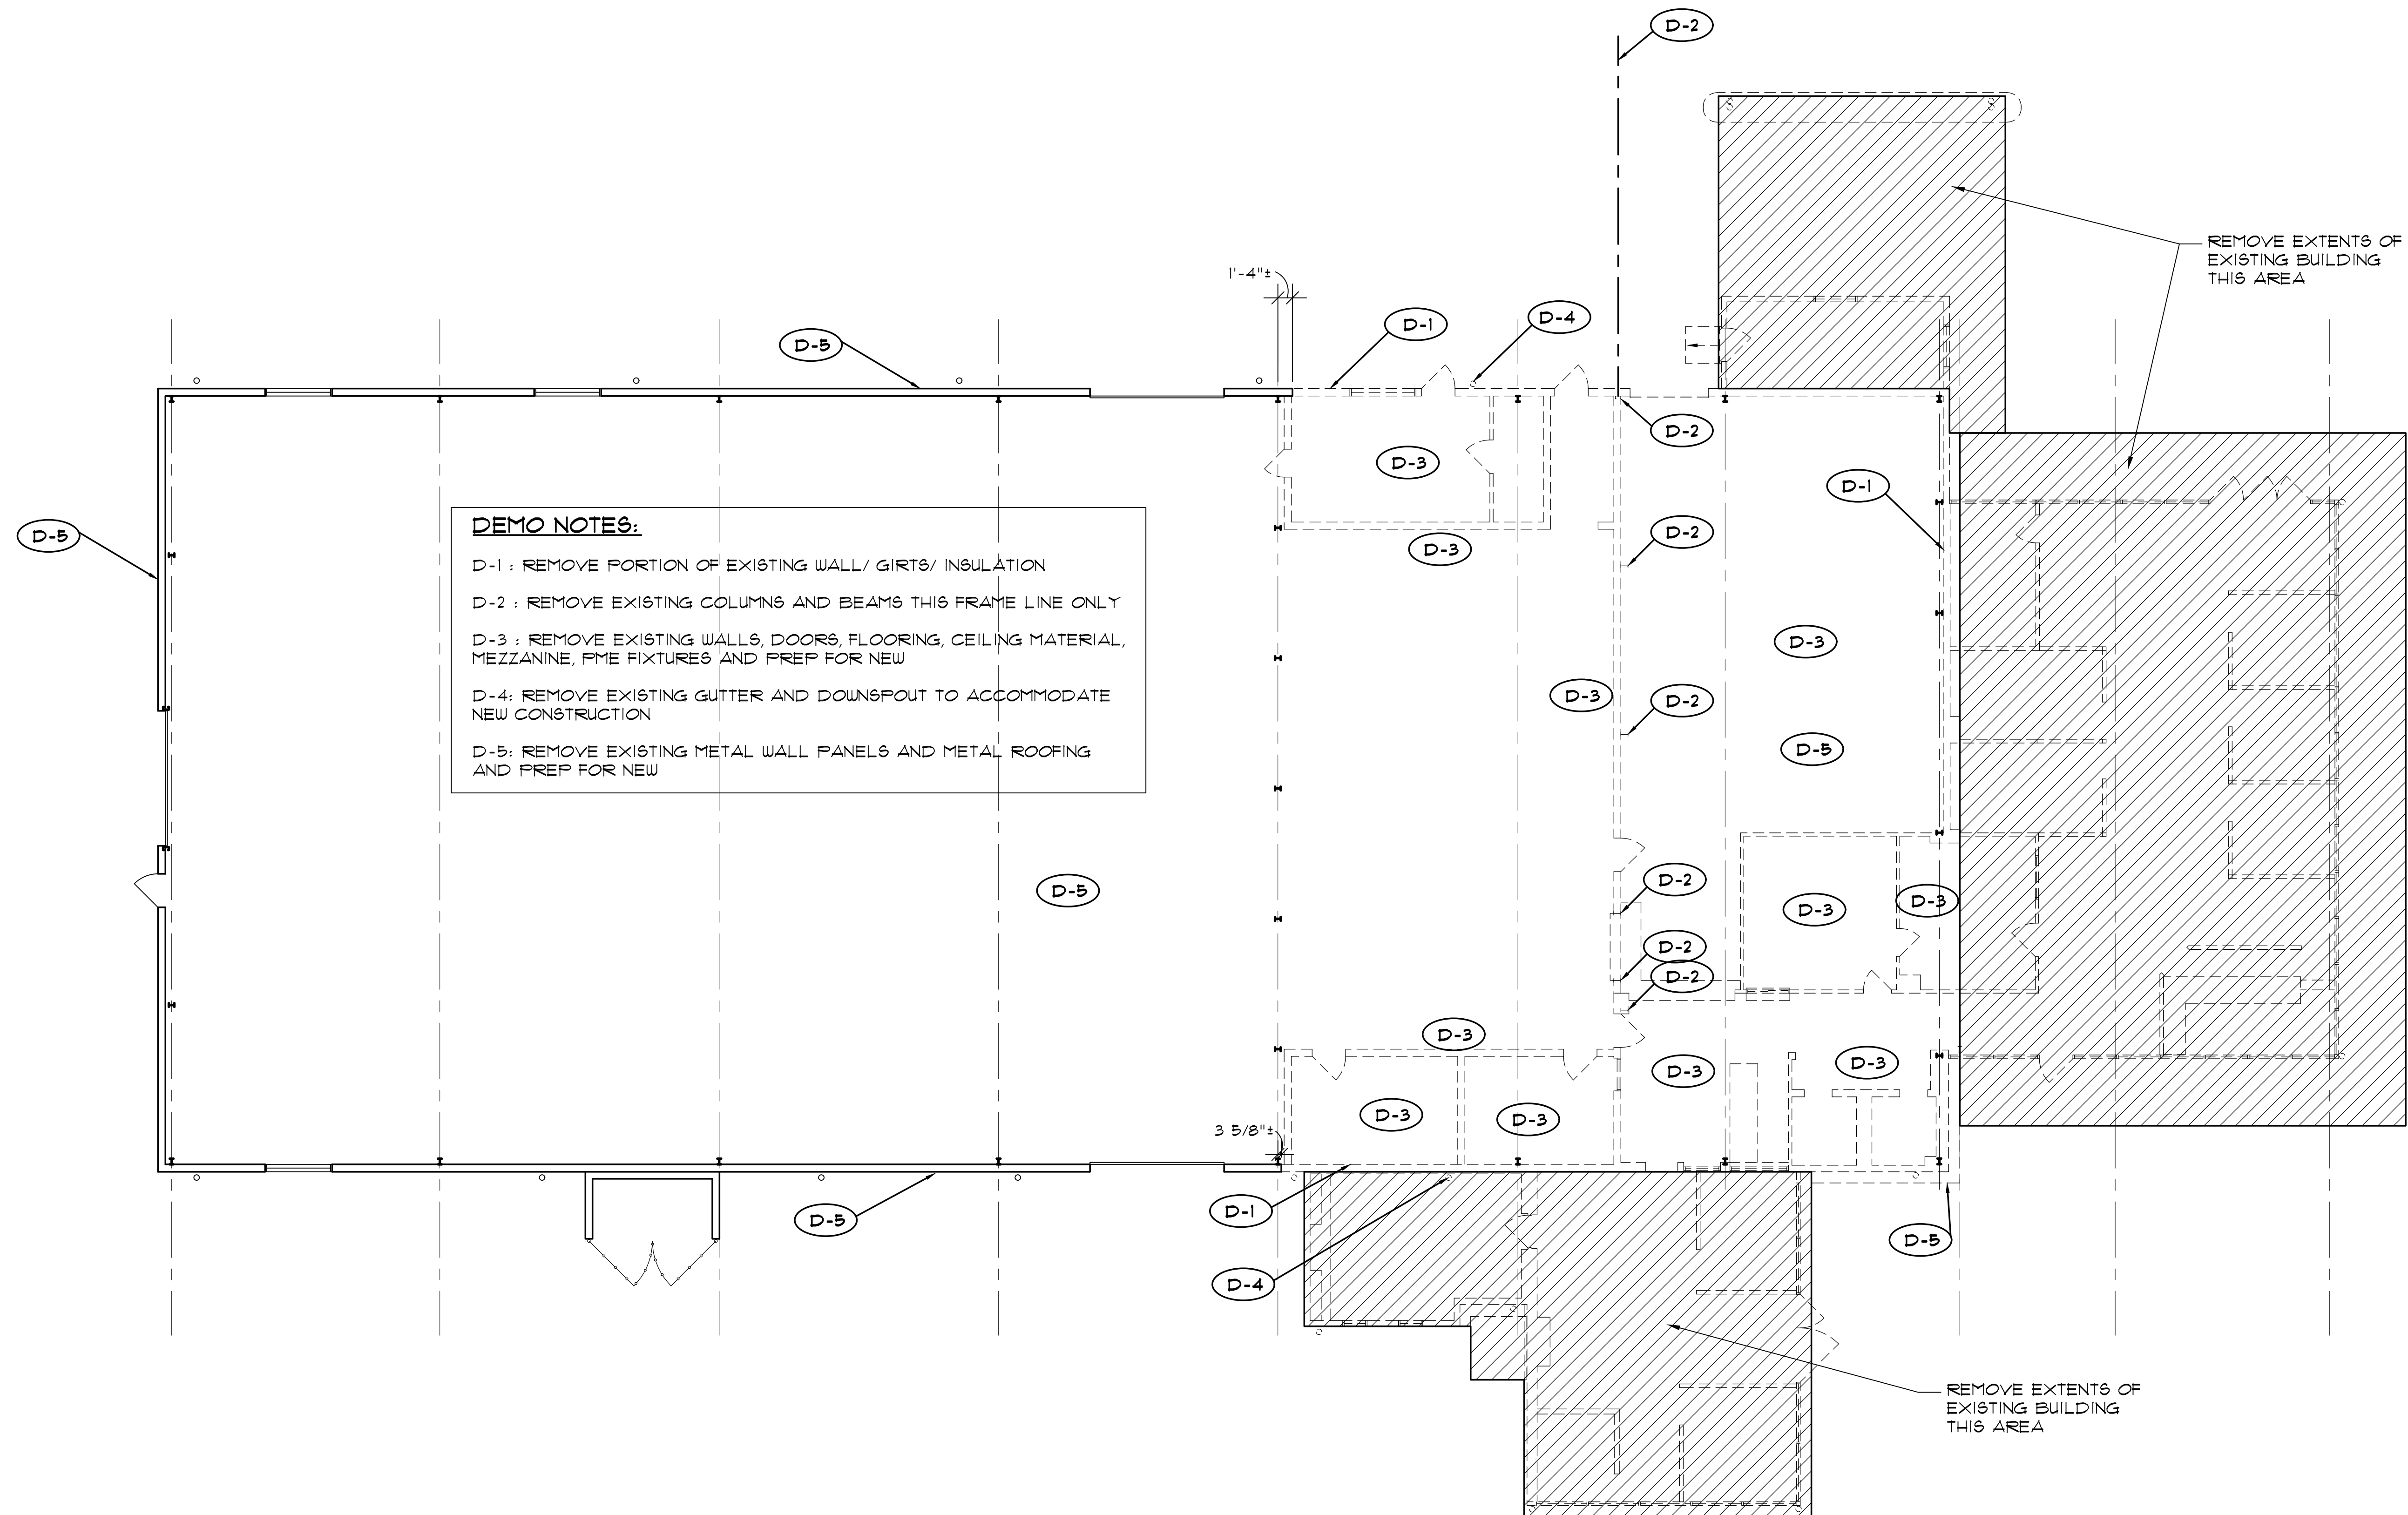

DEMO PLAN
SCALE: 1/8" = 1'-0"

WALL SCHEDULE	
1	12" SMOOTH FACE CMU TO ROOF DECK - PAINTED BOTH SIDES
2	12" SMOOTH FACE CMU TO ROOF DECK W/ 1 1/2" METAL STUDS & 3/8" GWB FURRING (EACH SIDE)
3	3 3/8" METAL STUDS @ 16" O.C. & 3/8" GWB BOTH SIDES TO 6" ABOVE CEILING BRACE TO STRUCTURE, INSTALL SOUND OR BATT INSULATION
4	3 3/8" METAL STUDS @ 16" O.C. & 3/8" GWB TO FLOOR STRUCTURE/ROOF DECK, INSTALL SOUND OR BATT INSULATION
5	6" METAL STUDS (PLUMBING WALL) TO FLOOR STRUCTURE ABOVE (SEE ALSO ROOM FINISH SCHEDULE)
6	FURR OUT AROUND INTERIOR OF COLUMN W/ 2 1/2" METAL STUDS AND 3/8" GWB-FTD TO 10'-0" AFF.
7	6" METAL STUDS, DENS-GOLD & 4 ACH EIFS/ACH EXTERIOR, 3/8" GWB PAINTED INTERIOR, MIN R-19 INSULATION
8	6" METAL STUDS (GALV), DENS-GOLD & EIFS/ACH EXTERIOR, 3/8" GWB PAINTED INTERIOR, MIN R-19 INSULATION
9	6" METAL STUDS (GALV), DENS-GOLD & EIFS EXTERIOR, 3/8" GWB PAINTED INTERIOR, MIN R-19 INSULATION
10	6" METAL STUDS (GALV) TO EXISTING STRUCTURE, REUSE/REPAINT EXISTING EXTERIOR METAL WALL PANEL, 5/8" GWB-FTD INTERIOR

Coastal
Architecture
P.C.


• Architectural Design
• Planning
• Interiors

AIA
Member of the American Institute of Architects

Lee D. Dixon, Jr., AIA
252-247-2121
lee@coastalarchitecture.net

4206 Bridges St. Ext., Suite C
Morehead City, NC 28557
www.CoastalArchitecture.net

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

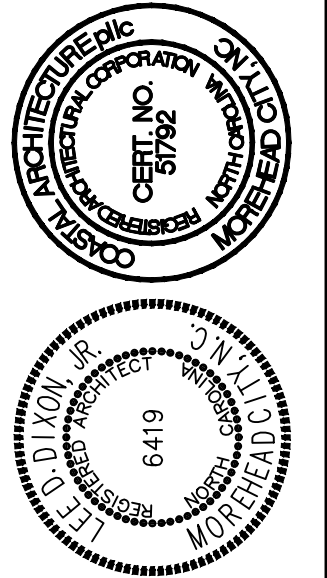


FLOOR PLAN

17038

ISSUED: 28 NOV 18
DWG BY: LSA, MES
CKD BY: LDD



REVISIONS

SHEET NO.
A-1
OF

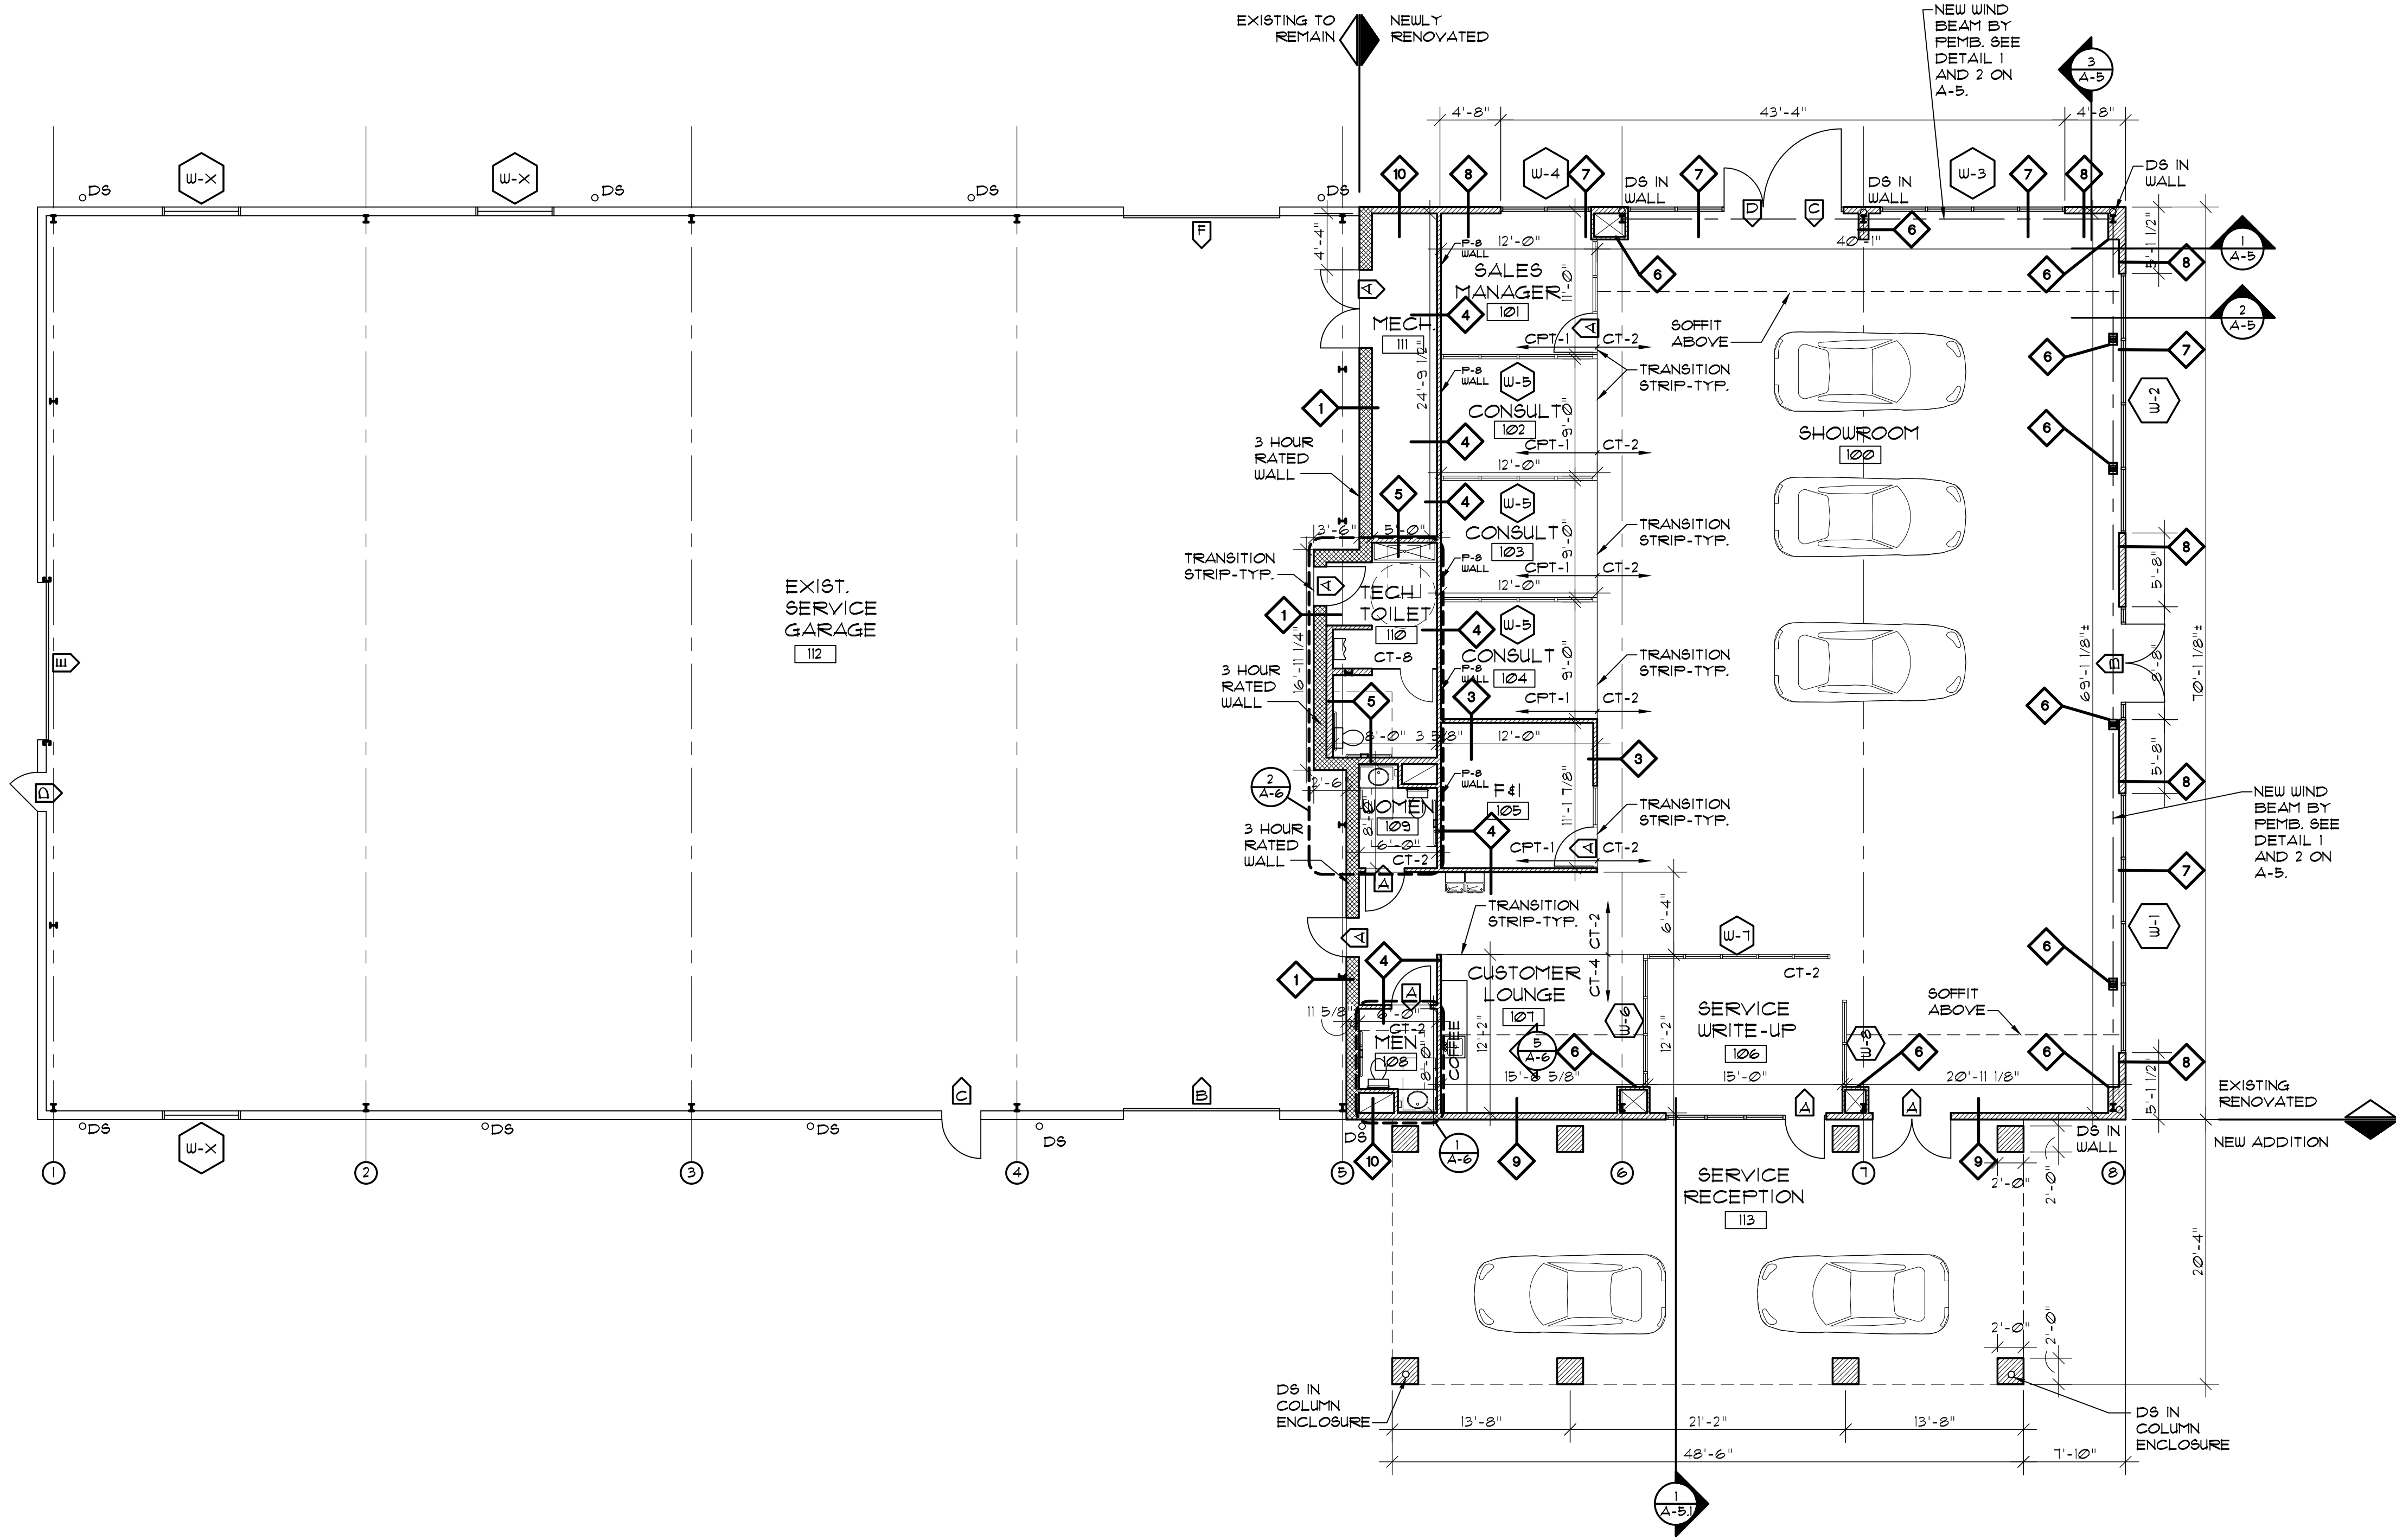

FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

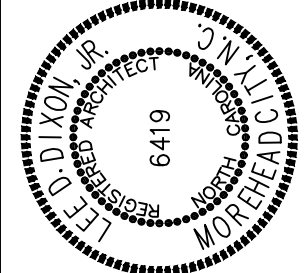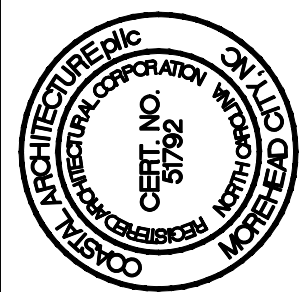

ROOF PLAN

17038

ISSUED: 28 NOV 18


DWG BY: LSA, MES

CKD BY: LDD



REVISIONS

SHEET NO.

A-1.1
OF

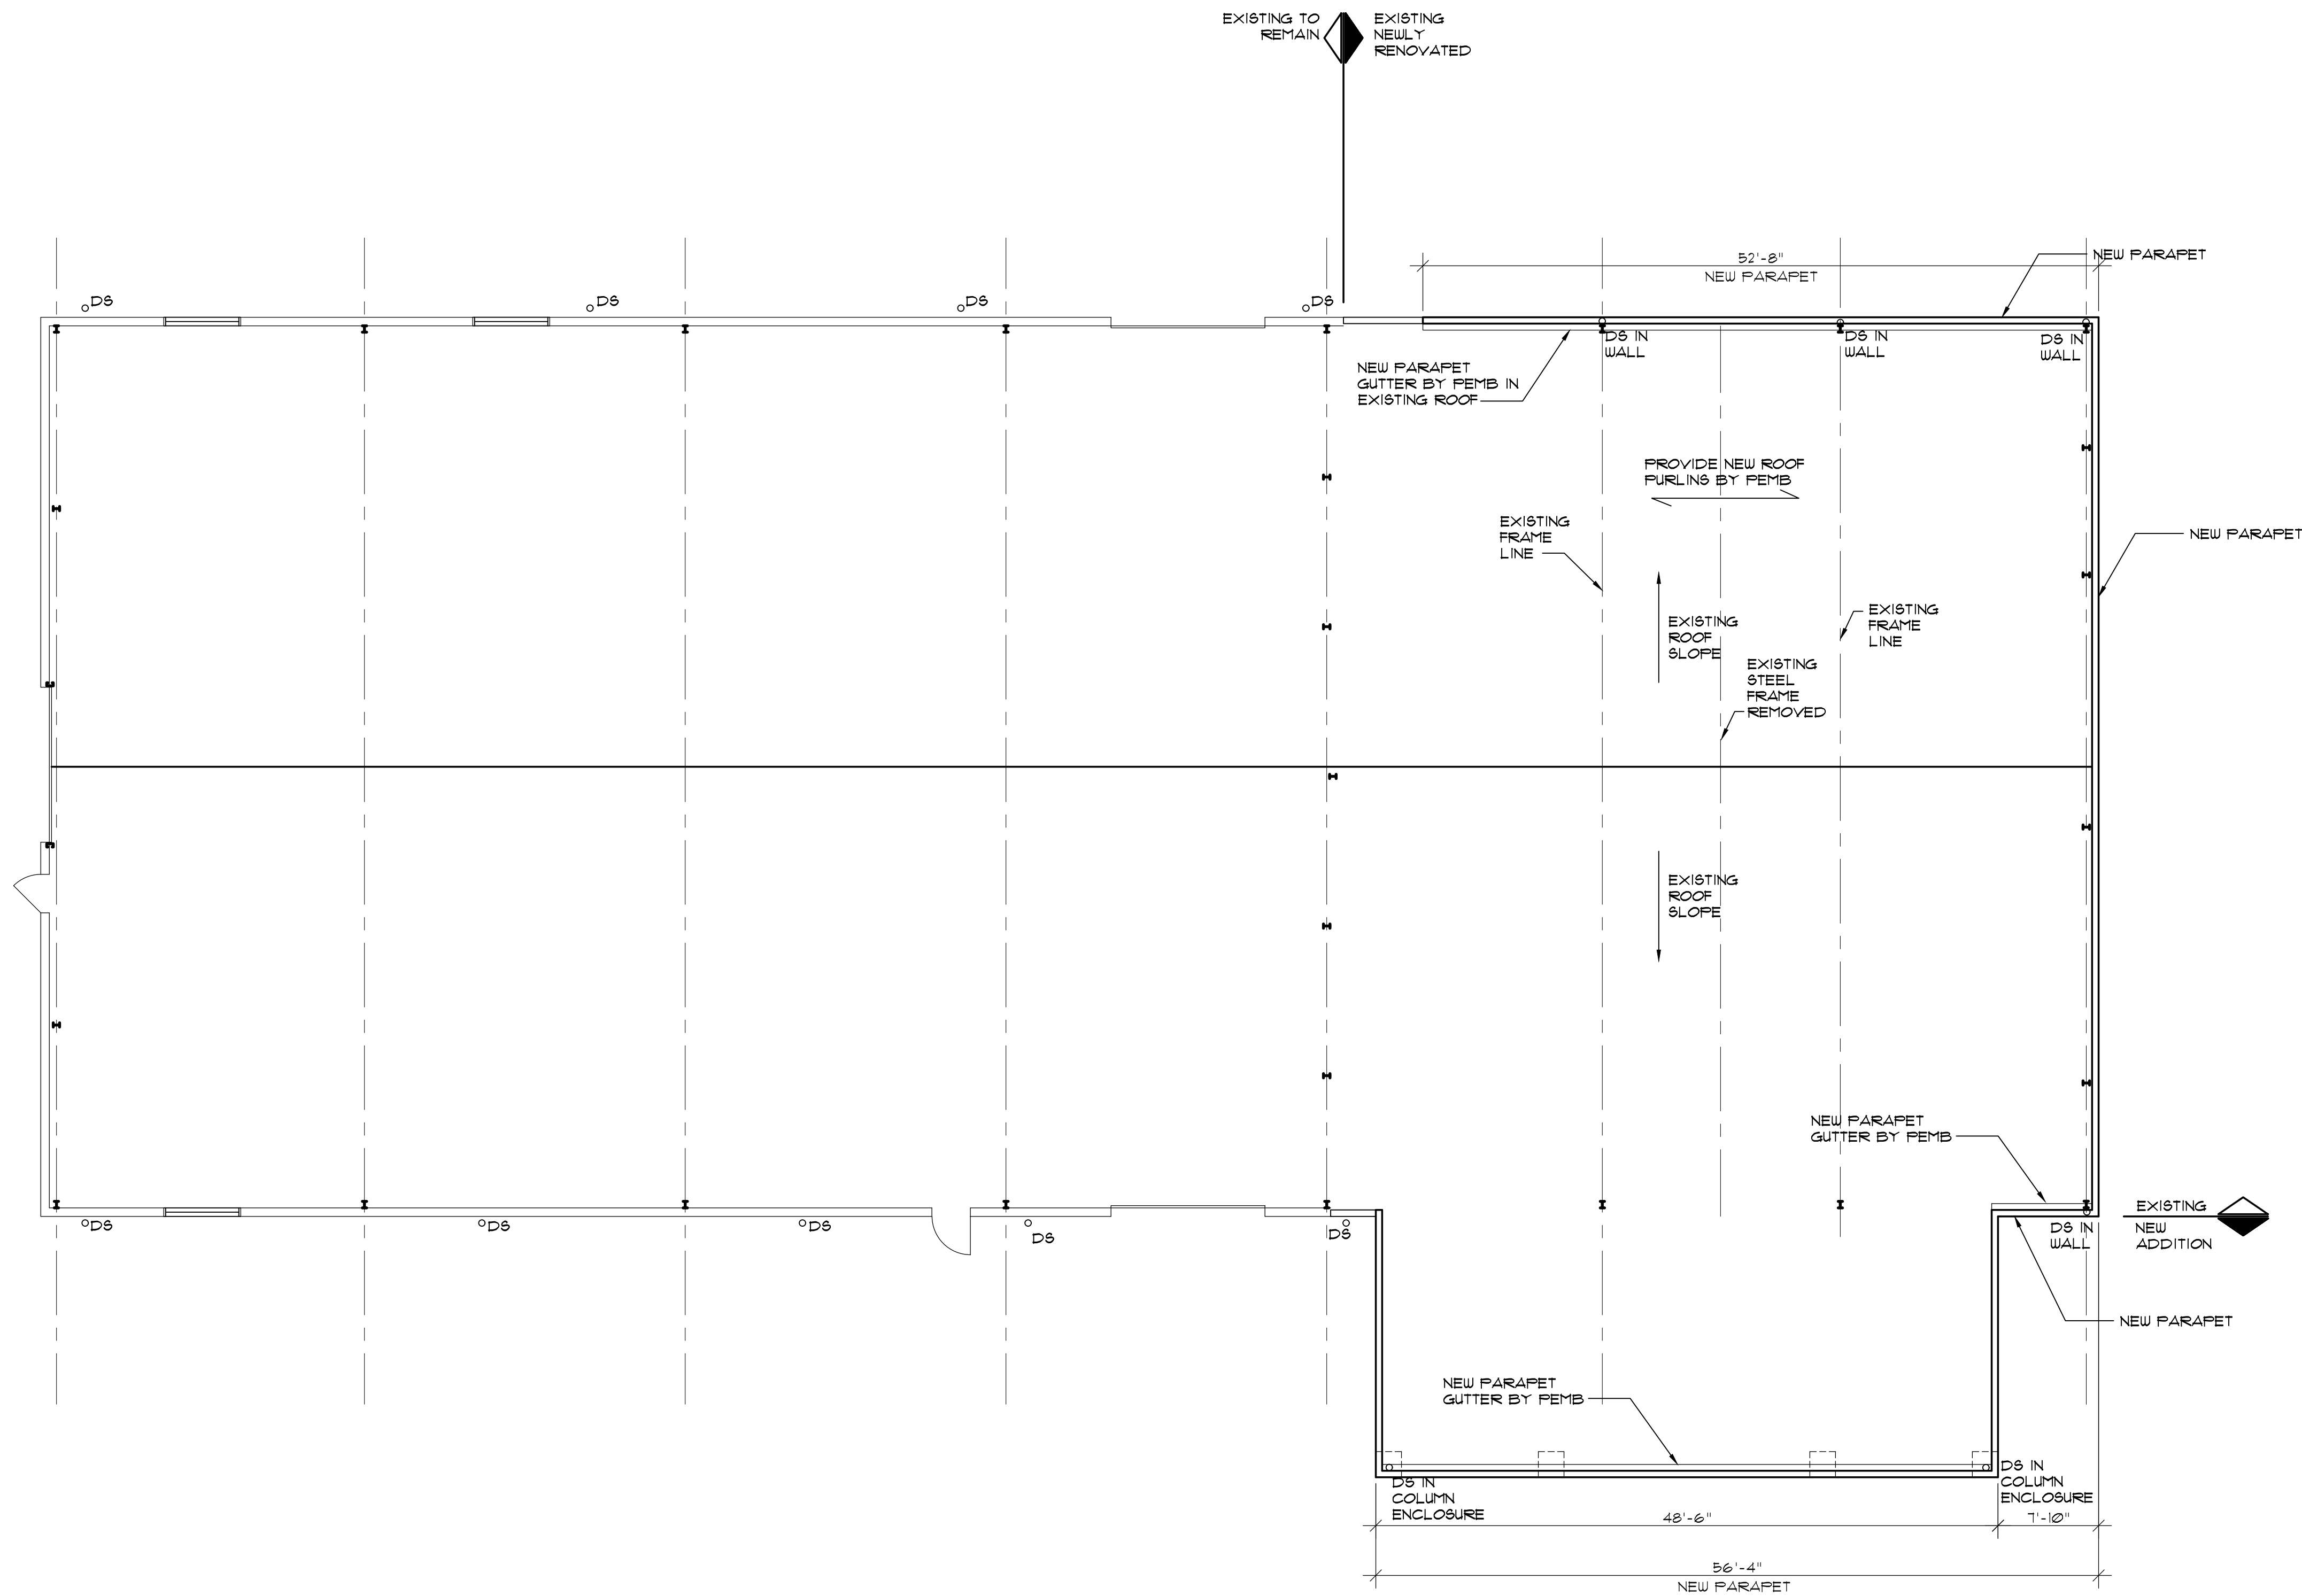


ROOF PLAN
SCALE: 1/8" = 1'-0"

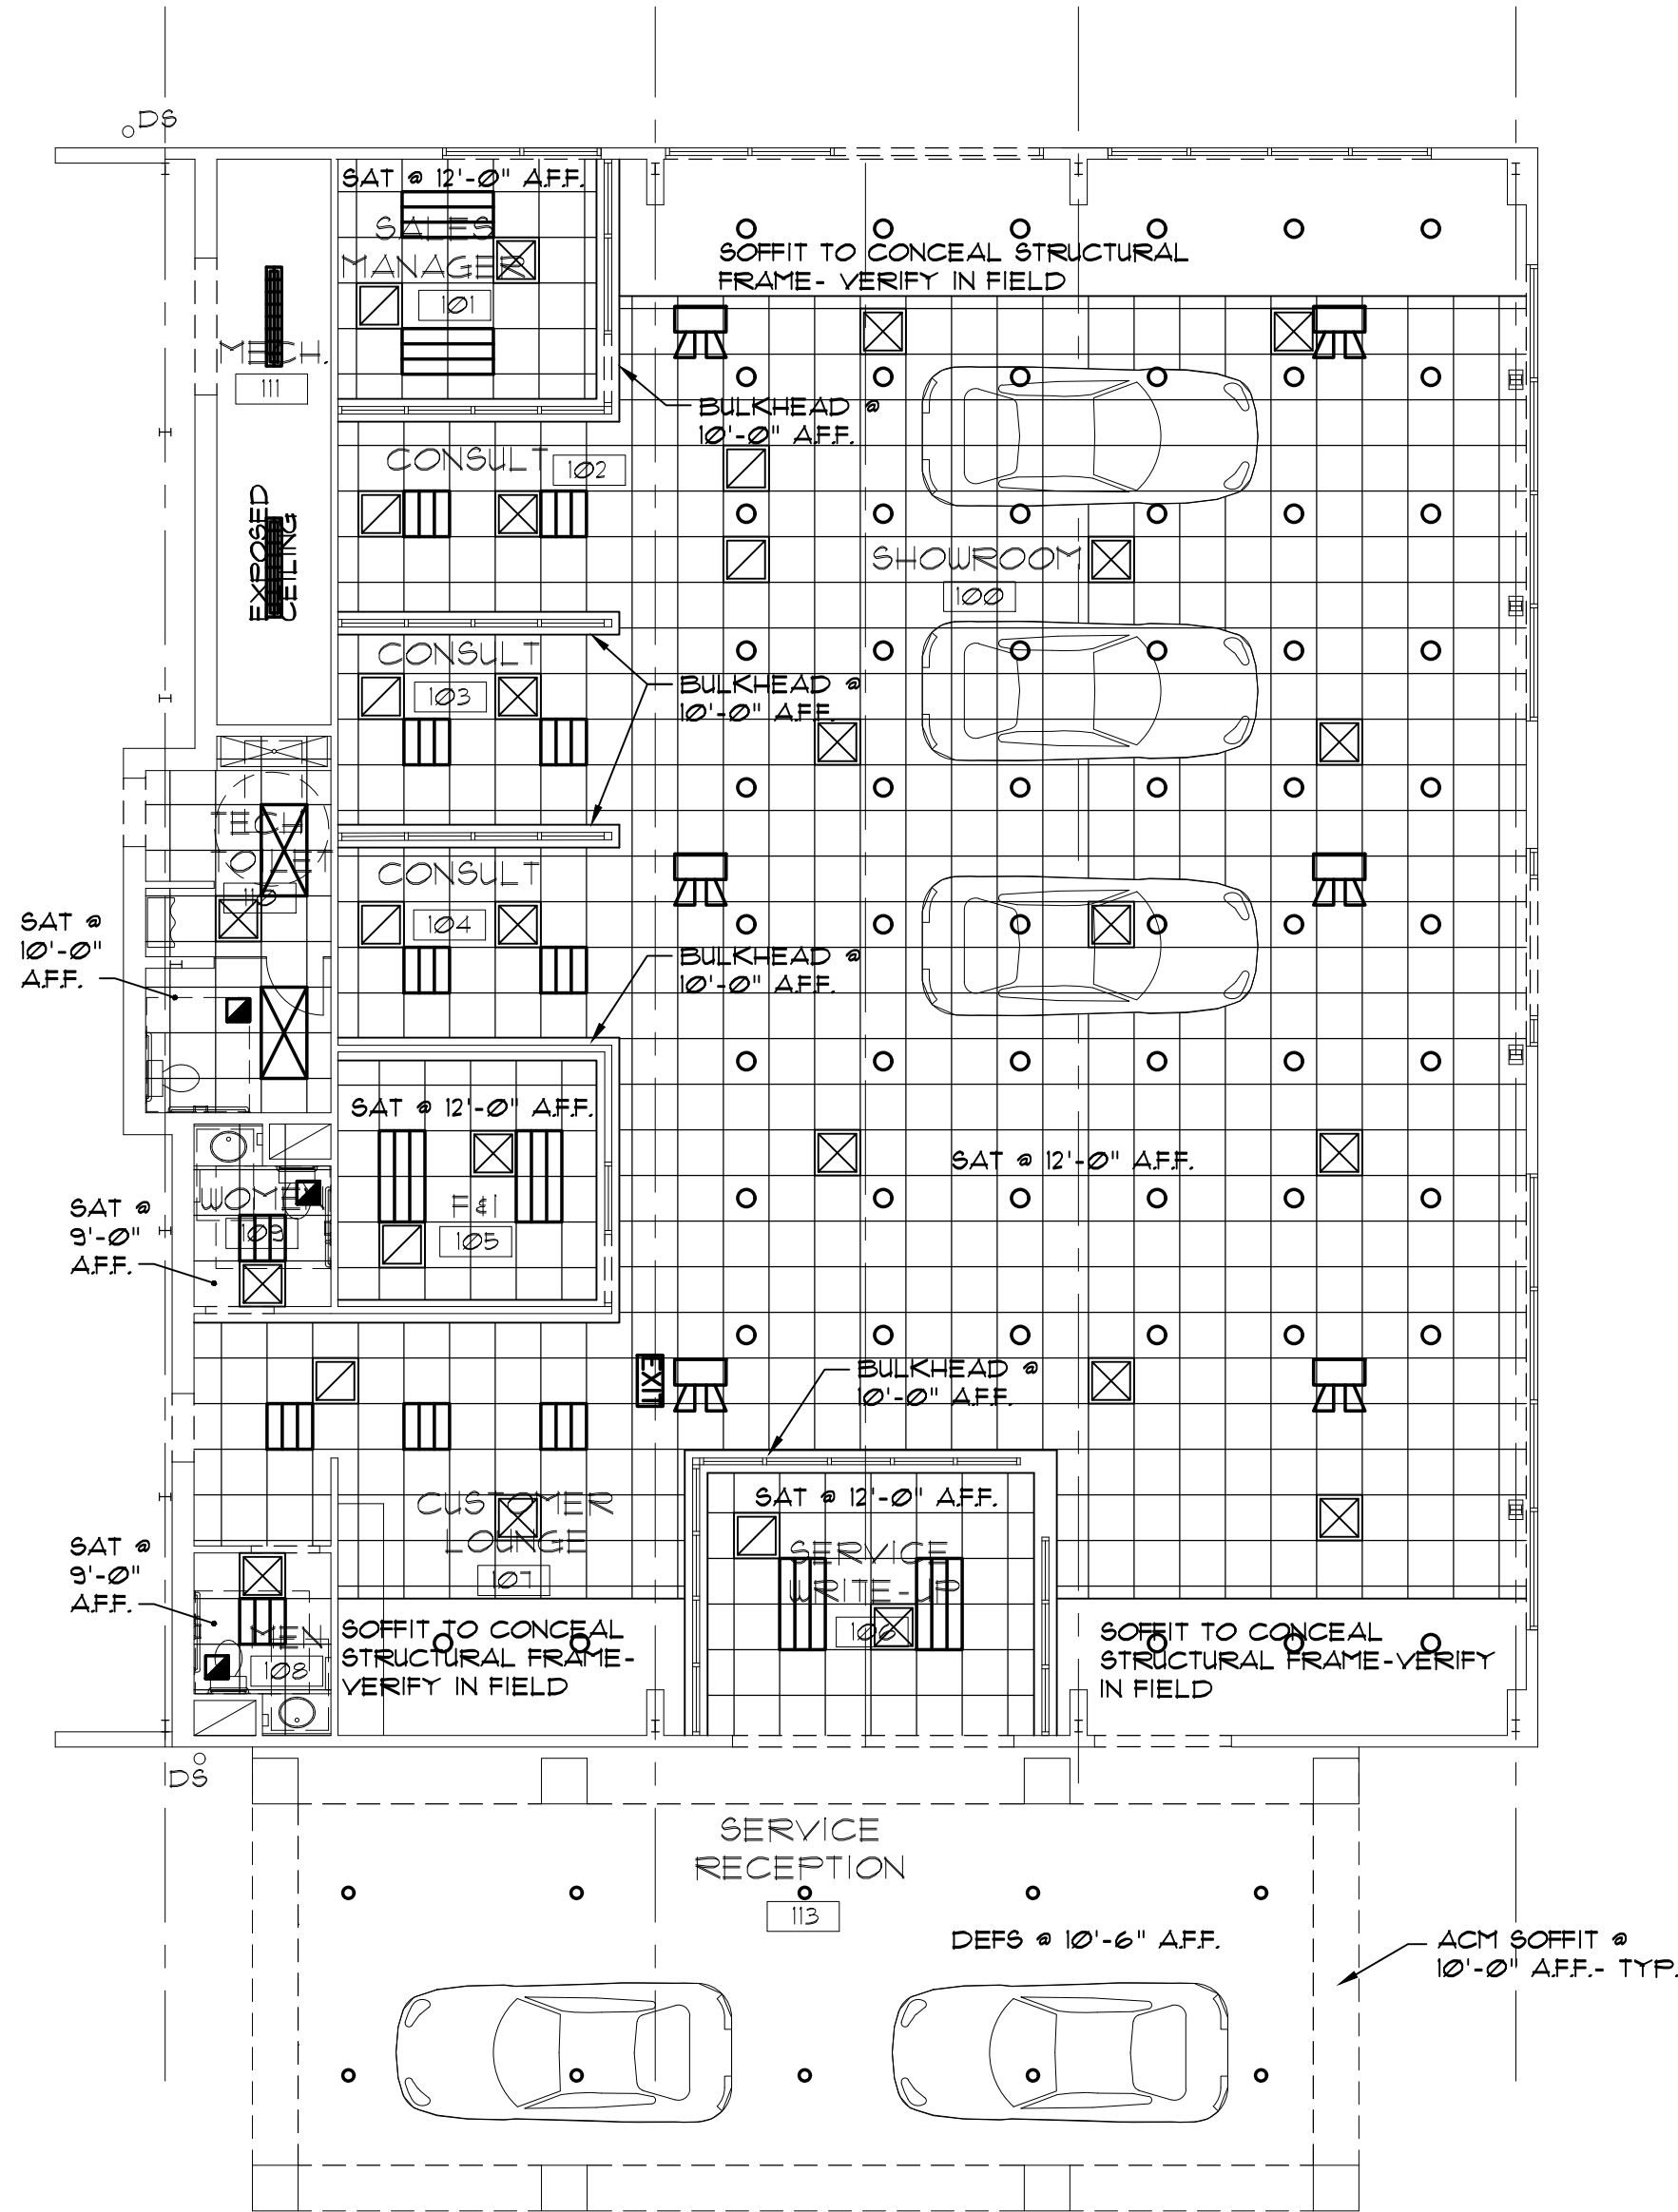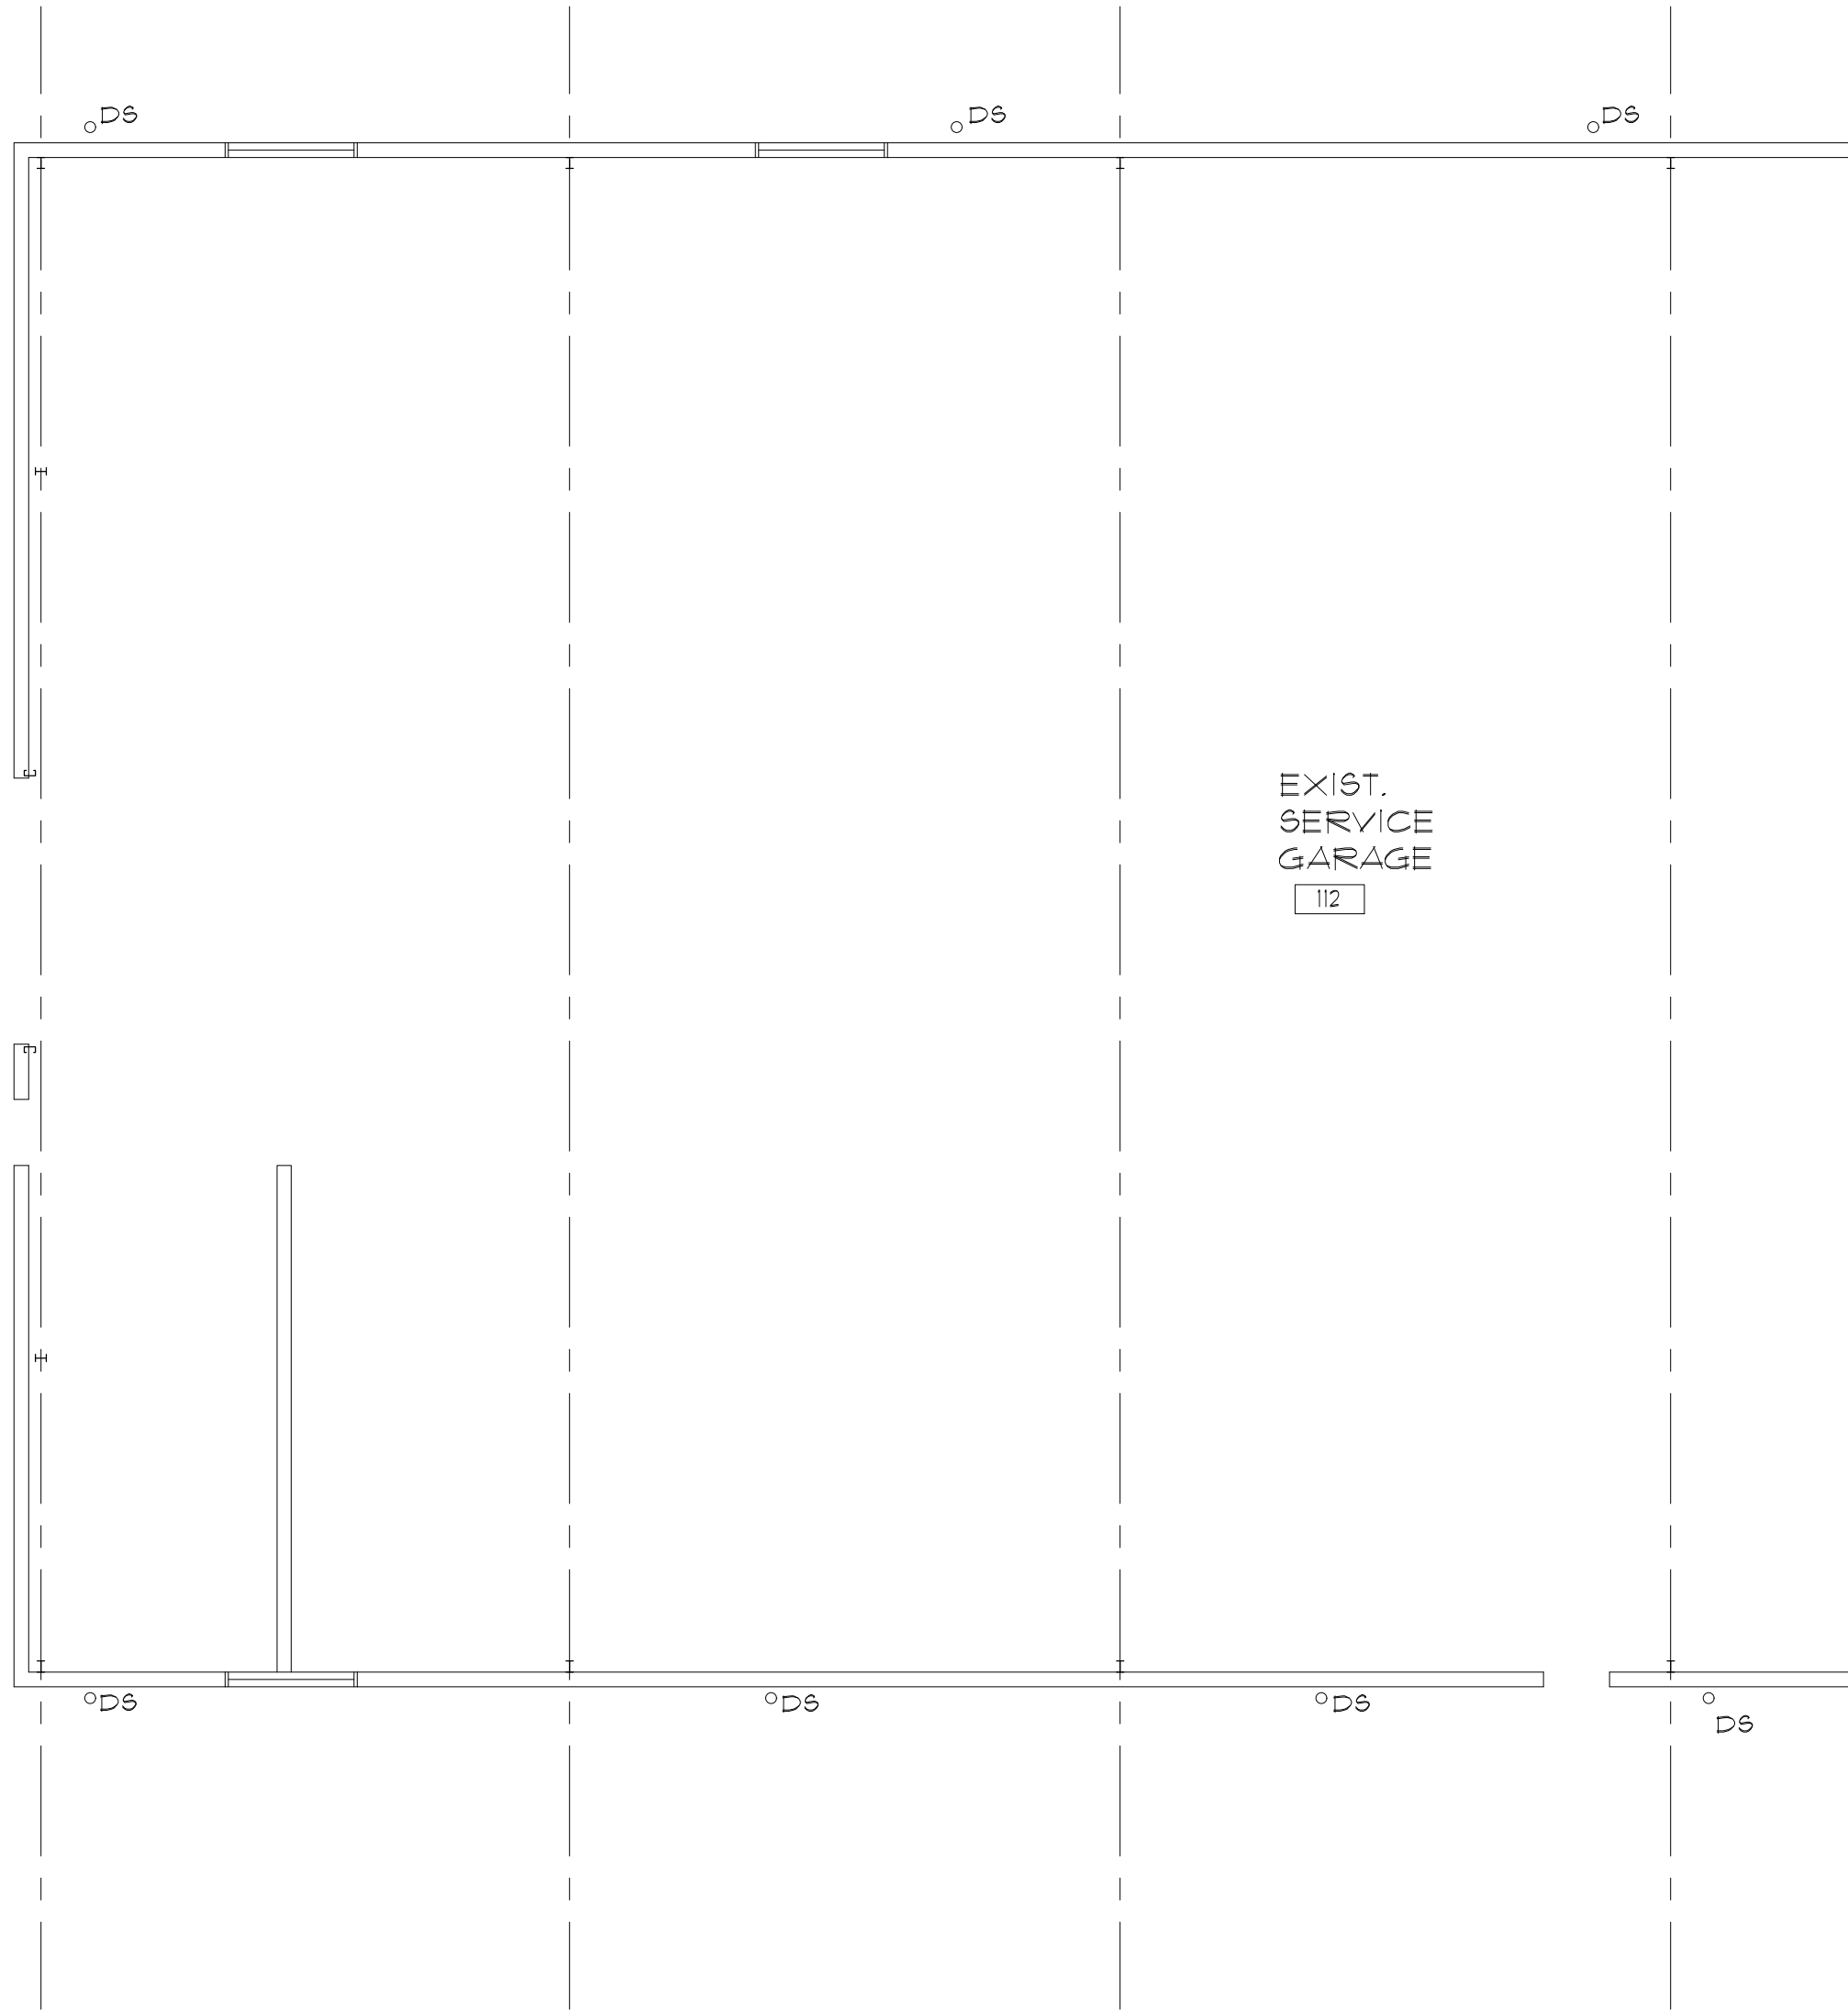

FIRST FLOOR REFLECTED CEILING PLAN
SCALE: 1/8" = 1'-0"

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

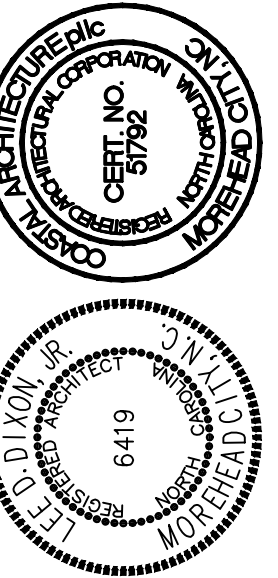

REFLECTED
CEILING PLAN

17038

ISSUED: 28 NOV 18
DWG BY: LSA
CKD BY: LDD

REVISIONS

SHEET NO.
A-2
OF

WINDOW SCHEDULE				
MARK	TYPE	SIZE (NOMINAL)	MODEL	REMARKS
W-1	ALUM. FIXED	19'-11" x 10'-0"	TRIFAB 45IT	
W-2	ALUM. FIXED	19'-11" x 10'-0"	TRIFAB 45IT	
W-3	ALUM. FIXED	14'-2" x 10'-0"	TRIFAB 45IT	
W-4	ALUM. FIXED	6'-11 3/8" x 10'-0"	TRIFAB 45IT	
W-5	ALUM. FIXED	12'-0" x 10'-0"	TRIFAB 45IT	
W-6	ALUM. FIXED	10'-2" x 10'-0"	TRIFAB 45IT	
W-7	ALUM. FIXED	14'-4" x 10'-0"	TRIFAB 45IT	
W-8	ALUM. FIXED	6'-8" x 10'-0"	TRIFAB 45IT	
ALUMINUM WINDOWS BY KAUKEER. PROVIDE LOW E INSULATED GLASS BY FPG. IMPACT GLAZING REQUIRED. SUBMIT GLAZING AND TINTING SAMPLES FOR APPROVAL. ALL WINDOWS AND ATTACHMENTS TO MEET WIND LOADS. SUBMIT FOR APPROVAL. NOTE: SUBMIT COLOR SAMPLES FOR OWNER SELECTION.				


DOOR SCHEDULE				
DOOR NO.	SIZE	DOOR		REMARKS
		MAT.	TYPE	
100A	(2) 3'-0" x 7'-0"	ALUM.	C	1
100B	(2) 3'-0" x 7'-0"		C	4
100C	6'-0" x 7'-0"		D	5
100D	3'-0" x 7'-0"		C	5
101A	3'-0" x 7'-0"		C	6
105A	3'-0" x 7'-0"		C	7
106A	3'-0" x 7'-0"		C	9
108A	3'-0" x 7'-0"	WD	A	2
109A	3'-0" x 7'-0"	WD	A	2
110A	3'-0" x 7'-0"	HM	B	3
111A	(2) 3'-0" x 7'-0"	HM	B	8
112A	3'-0" x 7'-0" - RATED DOOR	HM	B	3
112B	EXISTING TO REMAIN	-	-	-
112C	3'-0" x 7'-0"	HM	E	2
112D	EXISTING TO REMAIN	-	-	-
112E	EXISTING TO REMAIN	-	-	-
112F	EXISTING TO REMAIN	-	-	-

- ① PROVIDE CLOSER
② HOLD OPEN DEVICE
③ DOOR TO BE 404 VT DOOR TYPE, PG-HFPL - 5 HIGH PRESSURE DECORATIVE LAMINATE BONDED PARTICLE BOARD CORE 5-PLY CONSTRUCTION, NON RATED OR 20 MIN. FINISH: PLASTIC LAMINATE, D354-60 DESIGNER WHITE, MATTE FINISH


ROOM FINISH SCHEDULE									
ROOM NUMBERS	ROOM	FLOORS	BASE	WALLS	PRIMARY PAINT	ACCENT PAINT	CEILING	HEIGHT (NOMINAL)	REMARKS
100	SHOWROOM	CT-2	CTB-1	GWB-PTD	PI	-	ACT-1	12'-0"	
101	SALES MANAGER	CPT-1	RB-1	GWB-PTD	PI	P8			①
102	CONSULT	CPT-1	RB-1	GWB-PTD	PI	P8			①
103	CONSULT	CPT-1	RB-1	GWB-PTD	PI	P8			①
104	CONSULT	CPT-1	RB-1	GWB-PTD	PI	P8			①
105	F41	CPT-1	RB-1	GWB-PTD	PI	P8			①
106	SERVICE WRITE-UP	CT-2	CTB-1	GWB-PTD	PI				①
107	CUSTOMER LOUNGE	CT-4	CTB-1	GWB-PTD	PI				②
108	MENS	CT-2	CTB-1	CT-10, CT-12	PI			9'-0"	①
109	WOMENS	CT-2	CTB-1	CT-10, CT-12	PI			9'-0"	①
110	TECH TOILET	CT-8	CTB-1	CT-9/GWB/CMU-PTD	PI			10'-0"	③
111	MECHANICAL	EXIST. CONC.	RB-1	CMU/GWB-PTD	PI		EXPOSED STRUCT.	-	
112	EXIST. SERVICE GARAGE	EXIST. CONC.	-	-			-	-	
113	SERVICE RECEPTION	CONC.	-	-			DEFS	10'-6"	

NOTE: ① FLOORING TRANSITION TO BE SCHLUTER RENO-TK, FINISH: (AE) SATIN ANODIZED ALUMINUM
② FLOORING TRANSITION TO BE SCHLUTER SCHIENE, FINISH: (AE) SATIN ANODIZED ALUMINUM
③ FLOORING TRANSITION TO BE SCHLUTER RENO-U, FINISH: (AE) SATIN ANODIZED ALUMINUM


CODE	MATERIAL	MANUFACTURER	DESCRIPTION		
			PRODUCT	COLOR	DIMENSION
ACT-1	ACOUSTIC CEILING TILE	ARMSTRONG	DUNE ITTS	COLOR: WHITE EDGE DETAIL: 9/16" BEVELED TEGULAR GRID: INTERLUDE XL (9/16") DIMENSIONAL TEE GRID, COLOR: WHITE	24" X 24" X 5/8"
CPT-1	CARPET	MOHAUK COMMERCIAL	LEES CUSTOM MODULAR	STYLE NUMBER: J2894 COLOR: #41052 WROUGHT IRON	24" X 24" WIDE MODULAR TILE
CT-2	CERAMIC TILE	VINE STREET TILE STUDIOS	PORCELAIN	CARBON FINISH: POLISHED OR MATTE	24" X 24"
CT-4	CERAMIC TILE	DALTILE	YACHT CLUB	YC02 BRIDGE DECK	6" X 24"
CT-8	CERAMIC TILE	ROYAL MOSA	GLOBAL COLLECTION MOSA	15600V	12" X 12"
CT-9	CERAMIC TILE	ROYAL MOSA	1030 COLLECTION	13070	4" X 12"
CT-10	CERAMIC TILE	VINE STREET TILE STUDIOS	DIAMANTE FENDI AC	WHITE FINISH: SATIN	13" X 24" FIELD TILE
CTB-1	CERAMIC TILE BASE BULLNOSE	VINE STREET TILE STUDIOS	PORCELAIN	KARBON FINISH: POLISHED	3" X 12" BULLNOSE
P-1	PAINT	BENJAMIN MOORE	524 AURA EGGSHELL WATERBORNE INTERIOR PAINT	INTERIOR READY MIXED WHITE 01	
P-8	PAINT	BENJAMIN MOORE	524 AURA EGGSHELL WATERBORNE INTERIOR PAINT	212-50 STORMY MONDAY	
RB-1	RESILIENT BASE	ROPPE CORPORATION	PINNACLE STANDARD RUBBER WALL BASE	123 CHARCOAL TYPE TS	4" HEIGHT 1/8" THICKNESS
GR-1	GROUT	BOSTIK CERAMIC PRODUCTS	HYDROMENT TRU COLOR PRE-MIXED GROUT OR HYDROMENT CERAMIC TILE SANDED GROUT	COLOR: H195 SHADOW/ D-G44 COBBELSTONE	USED ON CT-2, CT-8, CT-9 ONLY
GR-2	GROUT	BOSTIK CERAMIC PRODUCTS	HYDROMENT TRU COLOR PRE-MIXED GROUT OR HYDROMENT CERAMIC TILE SANDED GROUT	COLOR: H142 FRENCH GRAY/ D-G06 STORM	USED ON CT-4 ONLY
GR-3	GROUT	BOSTIK CERAMIC PRODUCTS	HYDROMENT TRU COLOR PRE-MIXED GROUT OR HYDROMENT CERAMIC TILE SANDED GROUT	COLOR: H150 CLASSIC BONE/ D-G19 CLASSIC BONE	USED ON CT-10 ONLY

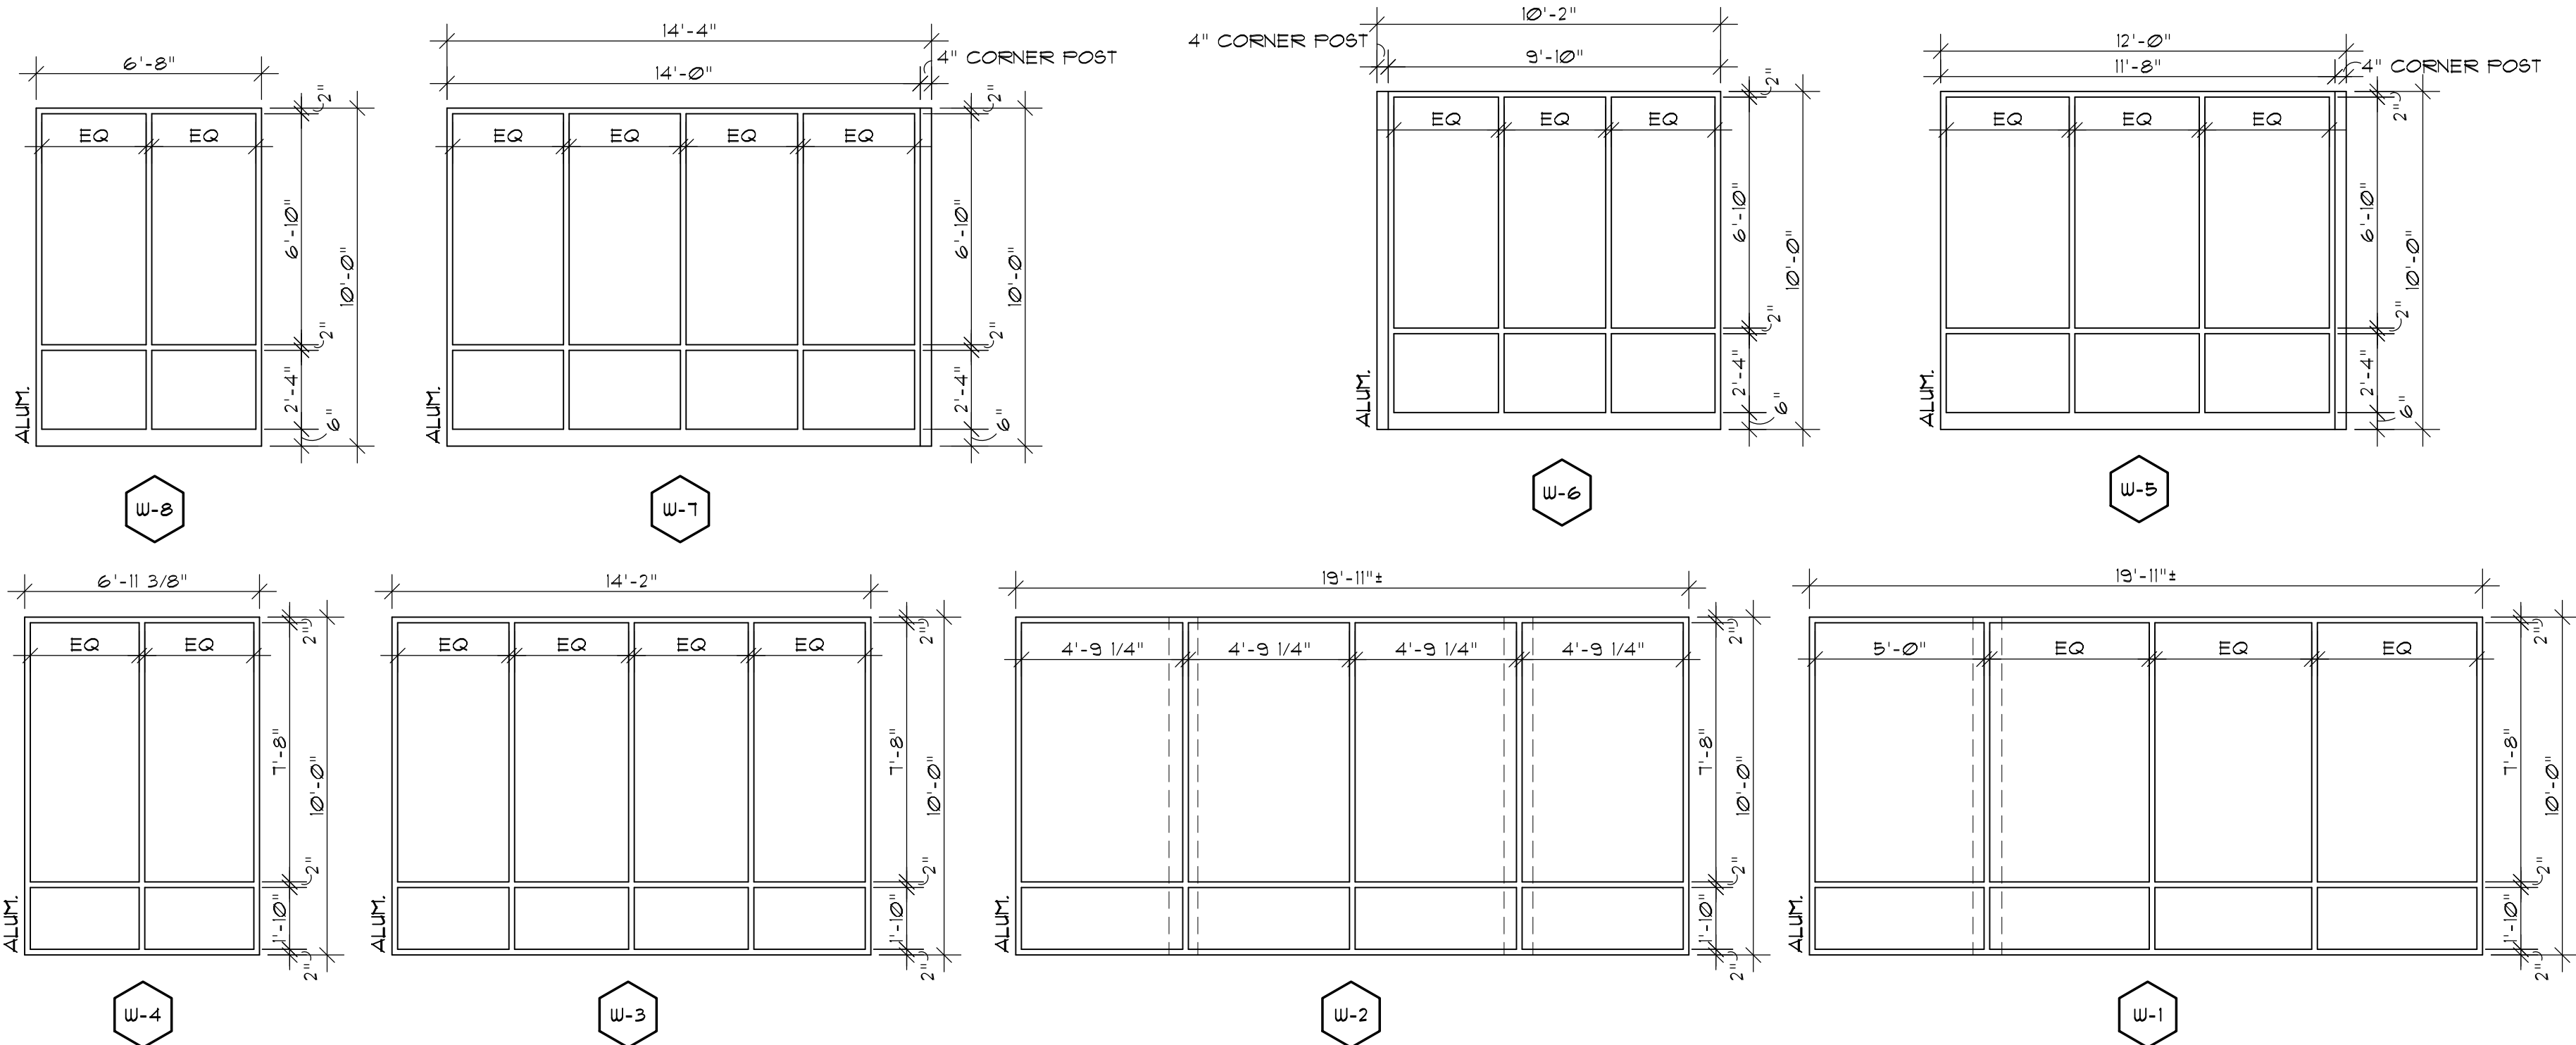

3 WINDOW ELEVATIONS
SCALE: 1/4" = 1'-0"

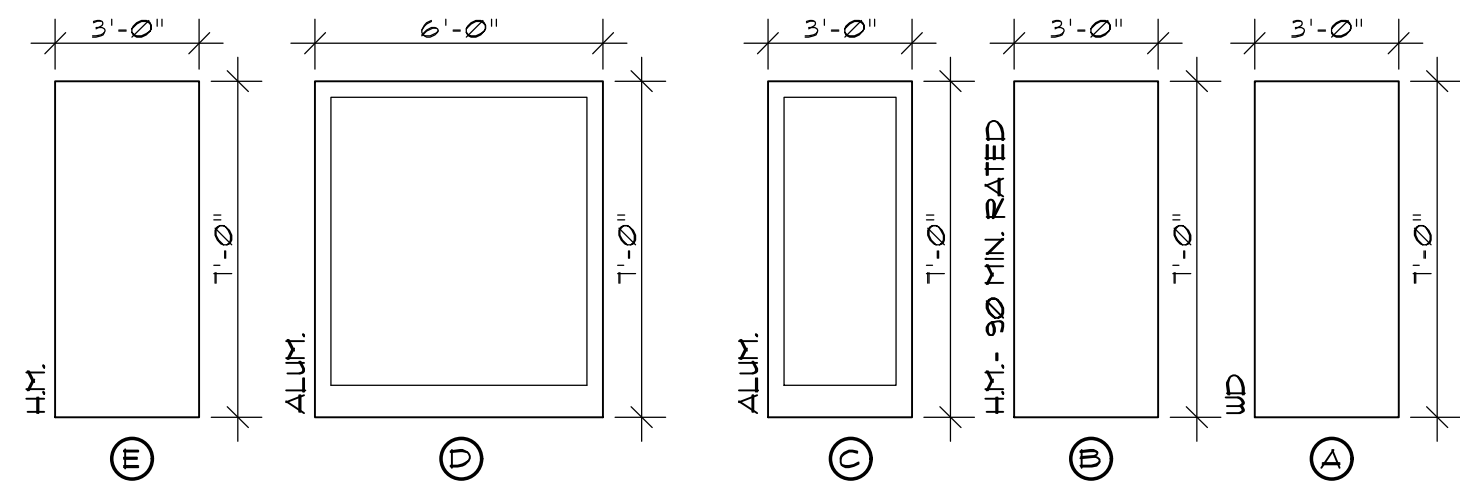

2 DOOR ELEVATIONS
SCALE: 1/4" = 1'-0"

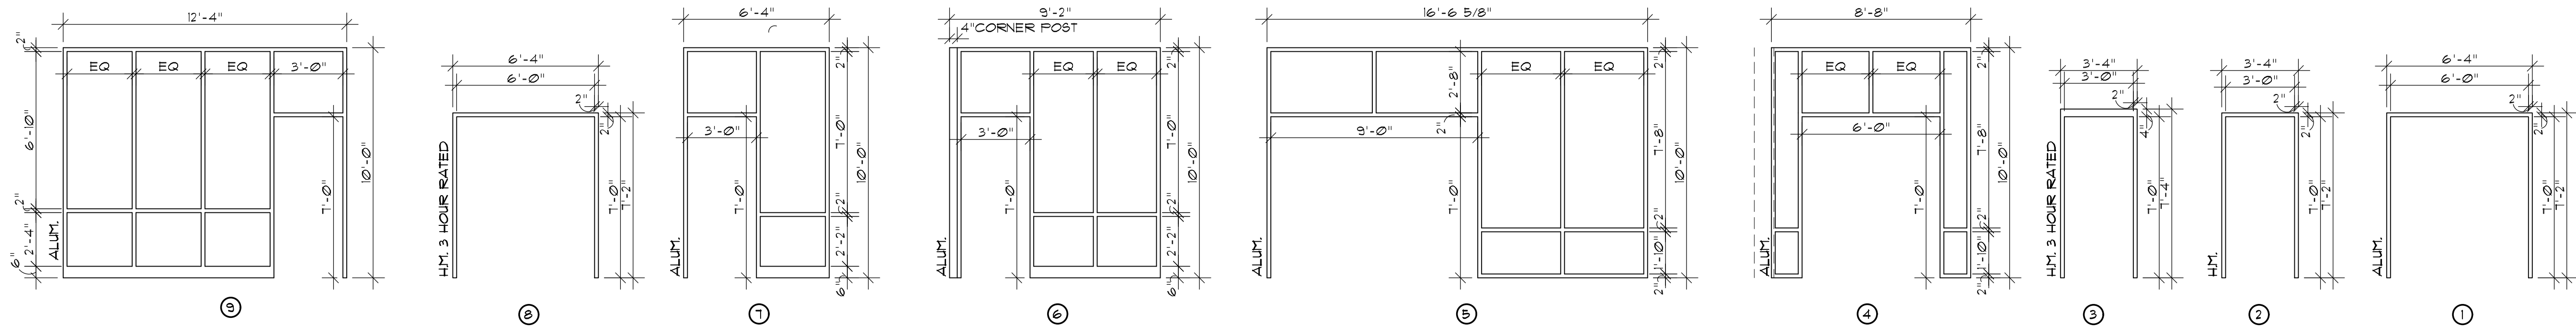

1 FRAME ELEVATIONS
SCALE: 1/4" = 1'-0"


Coastal Architecture
Architectural Design
Planning
Interiors

AIA
Member of the American Institute of Architects

Lee D. Dixon, Jr., AIA
252-247-2121
lee@coastalarchitecture.net

4206 Bridges St. Ext., Suite C
Morehead City, NC 28557
www.CoastalArchitecture.net


MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

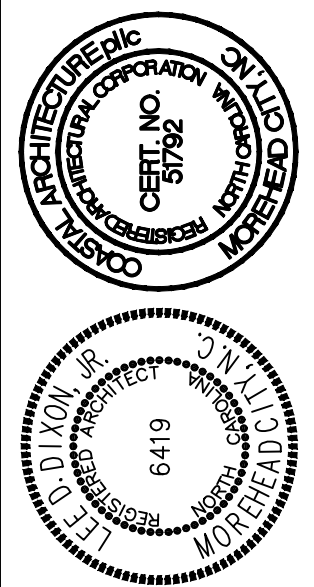



FINISH SCHEDULES

17038
ISSUED: 28 NOV 18
DWG BY: MES
CKD BY: LDD
REVISIONS

SHEET NO.
A-3
OF

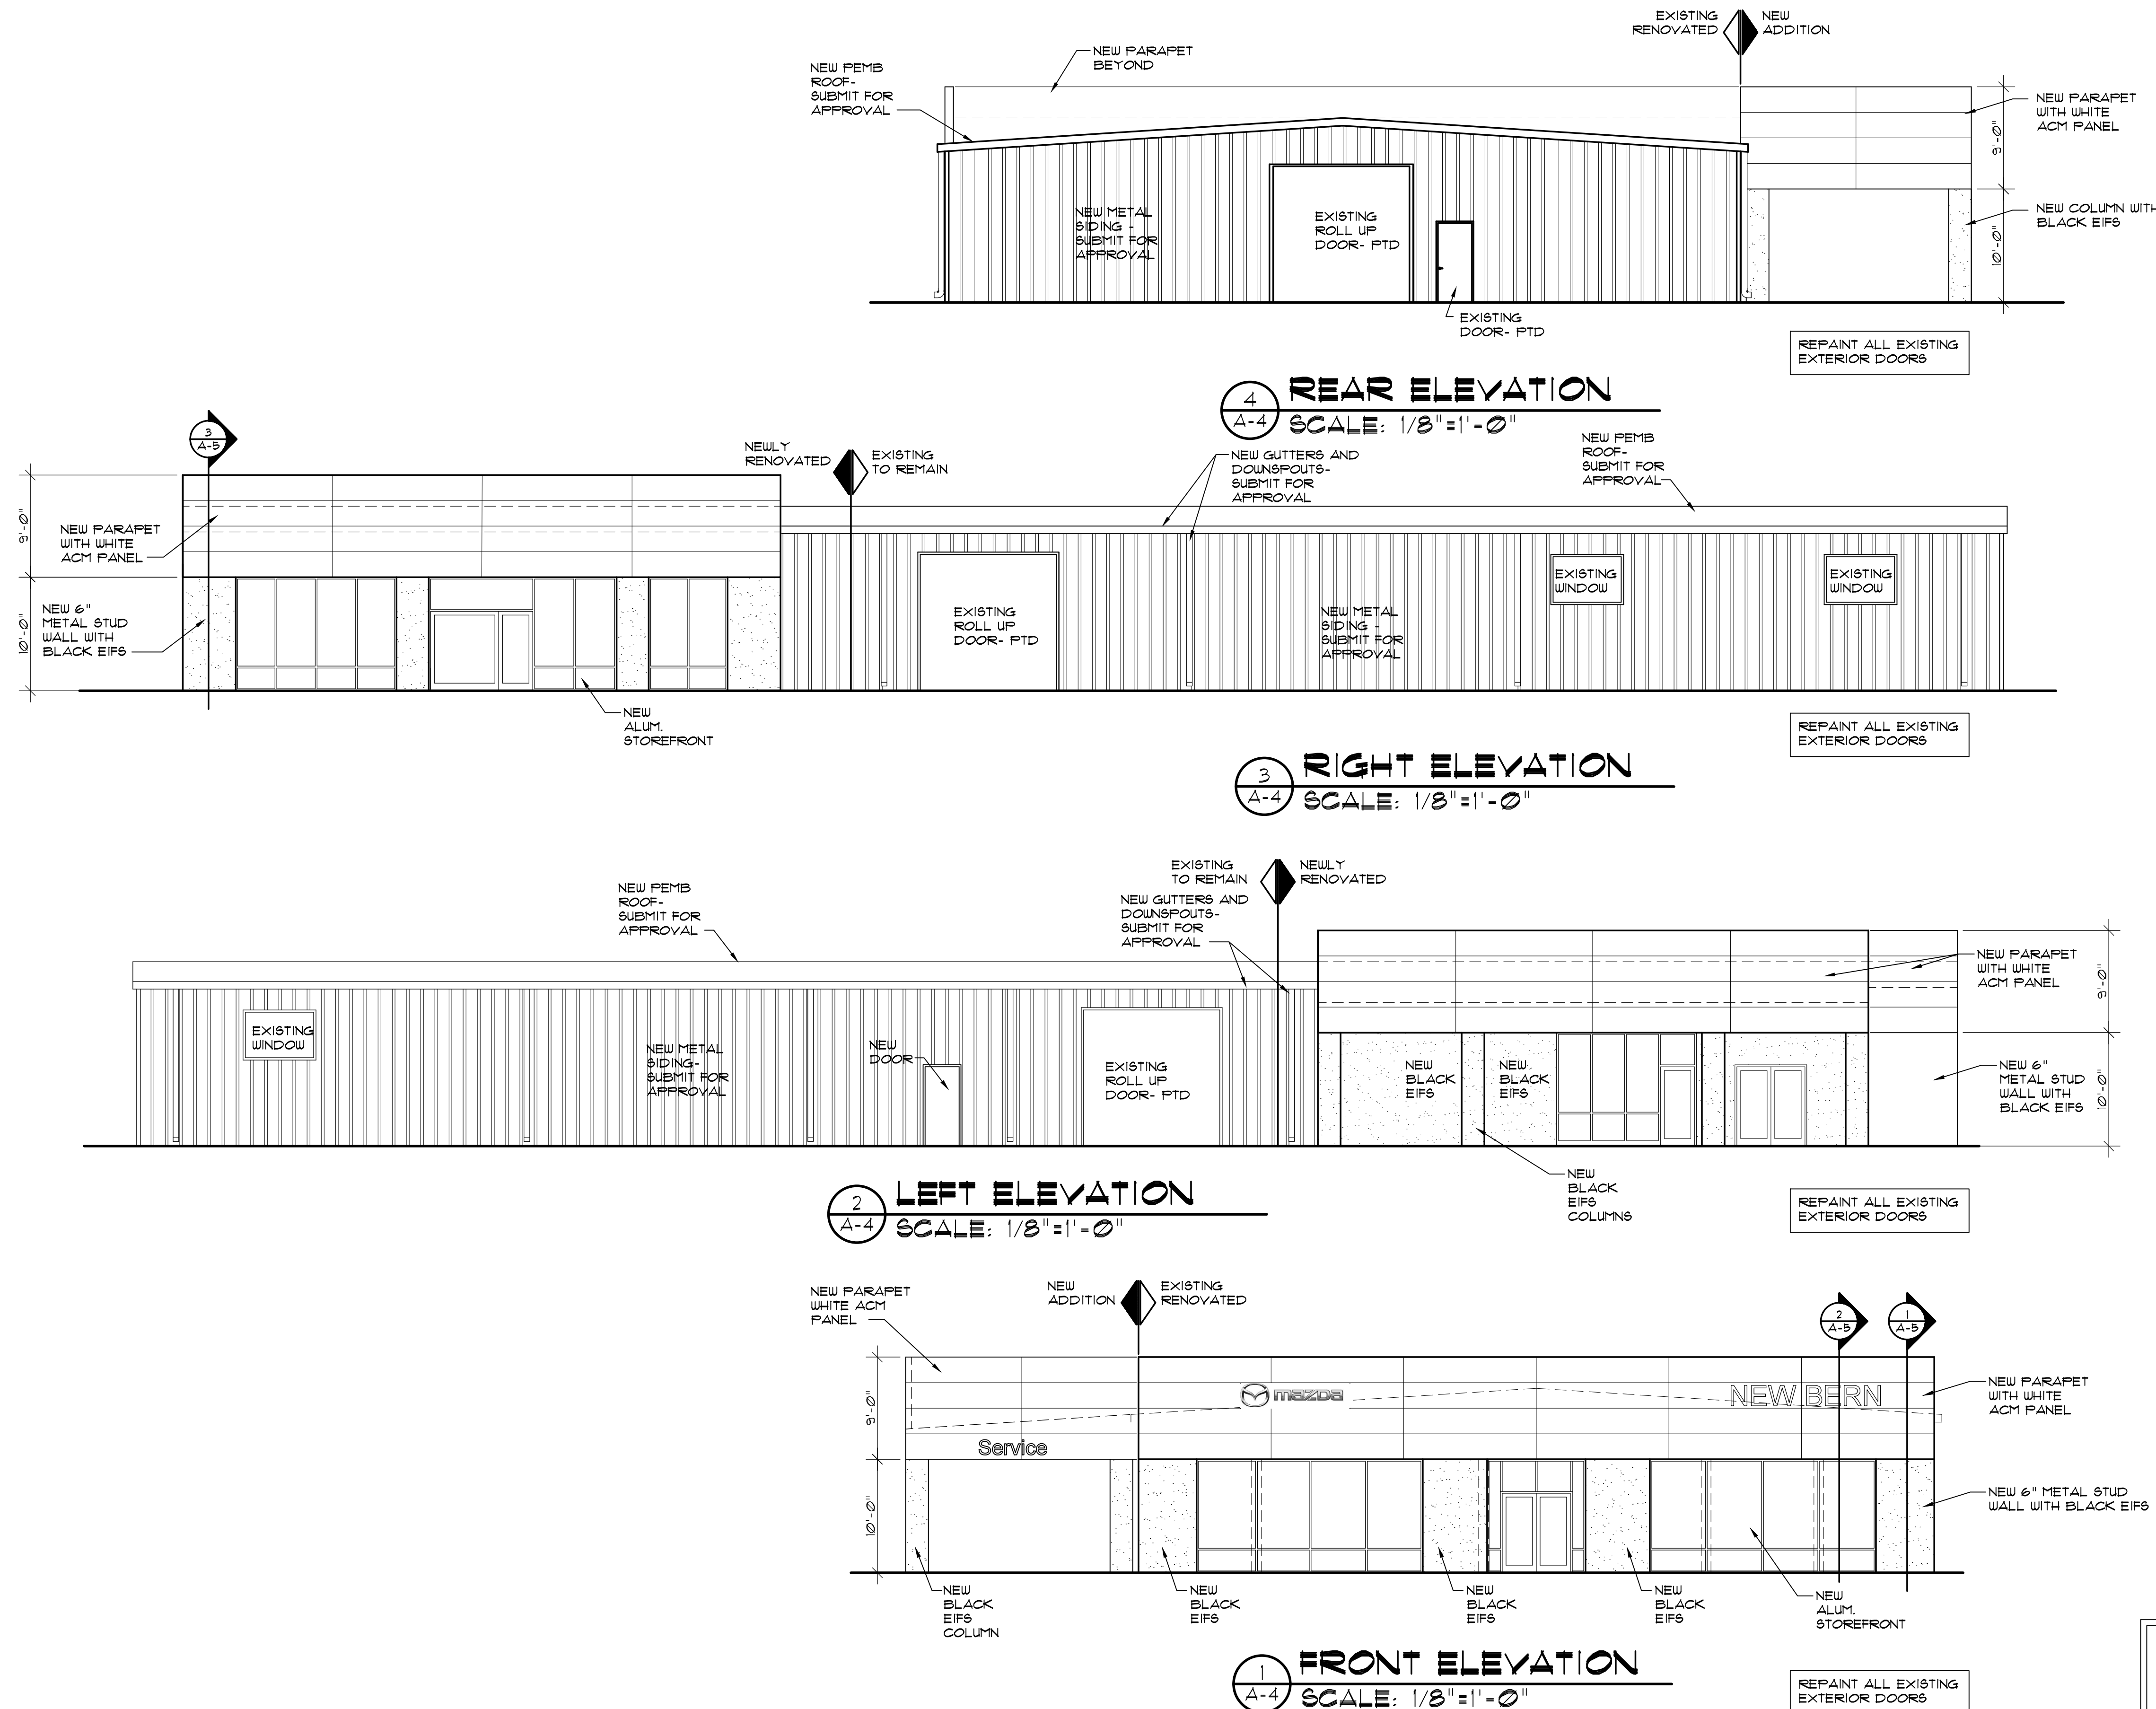

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

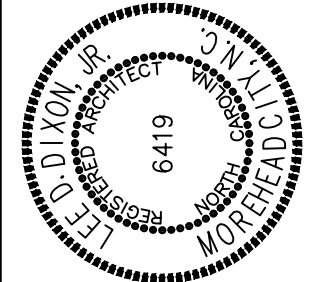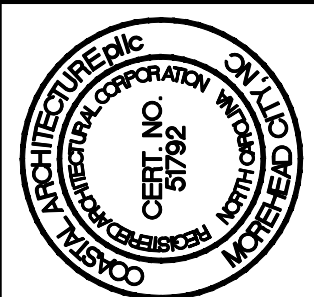

WALL SECTIONS

17038

ISSUED: 28 NOV 18


DWG BY: LSA

CKD BY: LDD


REVISIONS

SHEET NO.


A-5
OF

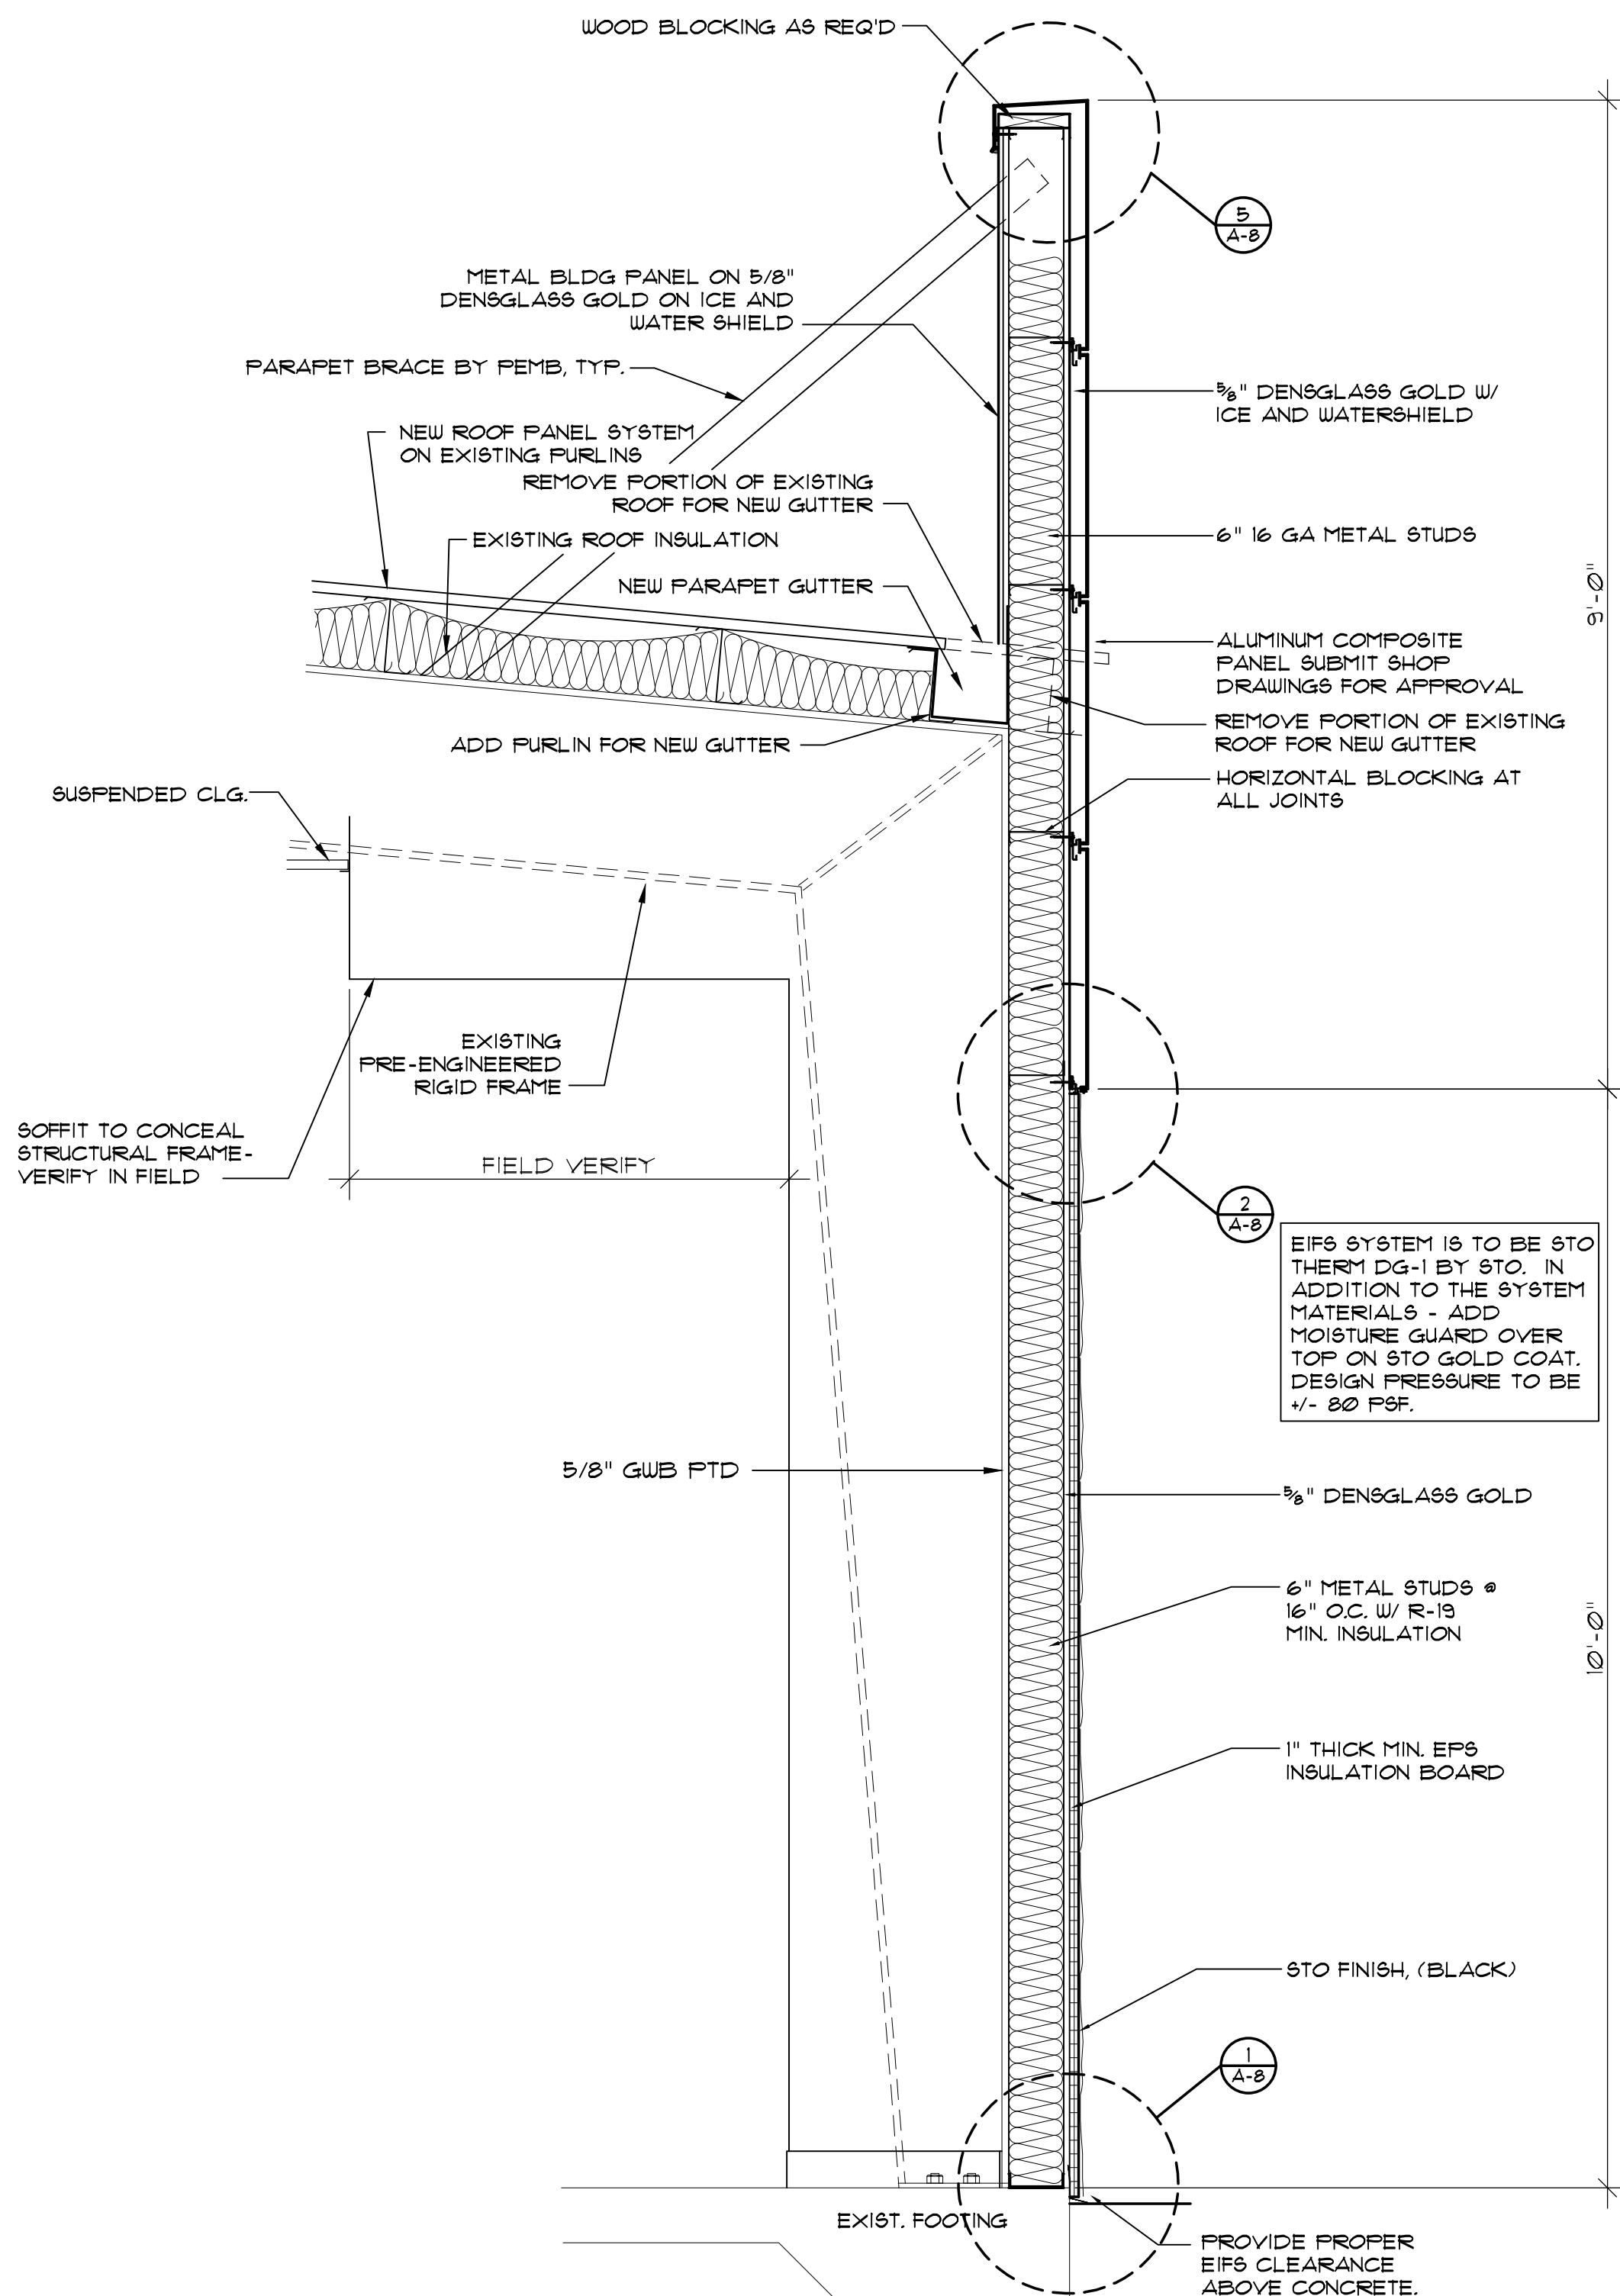

3 SECTION
A-5 SCALE: 3/4"=1'-0"


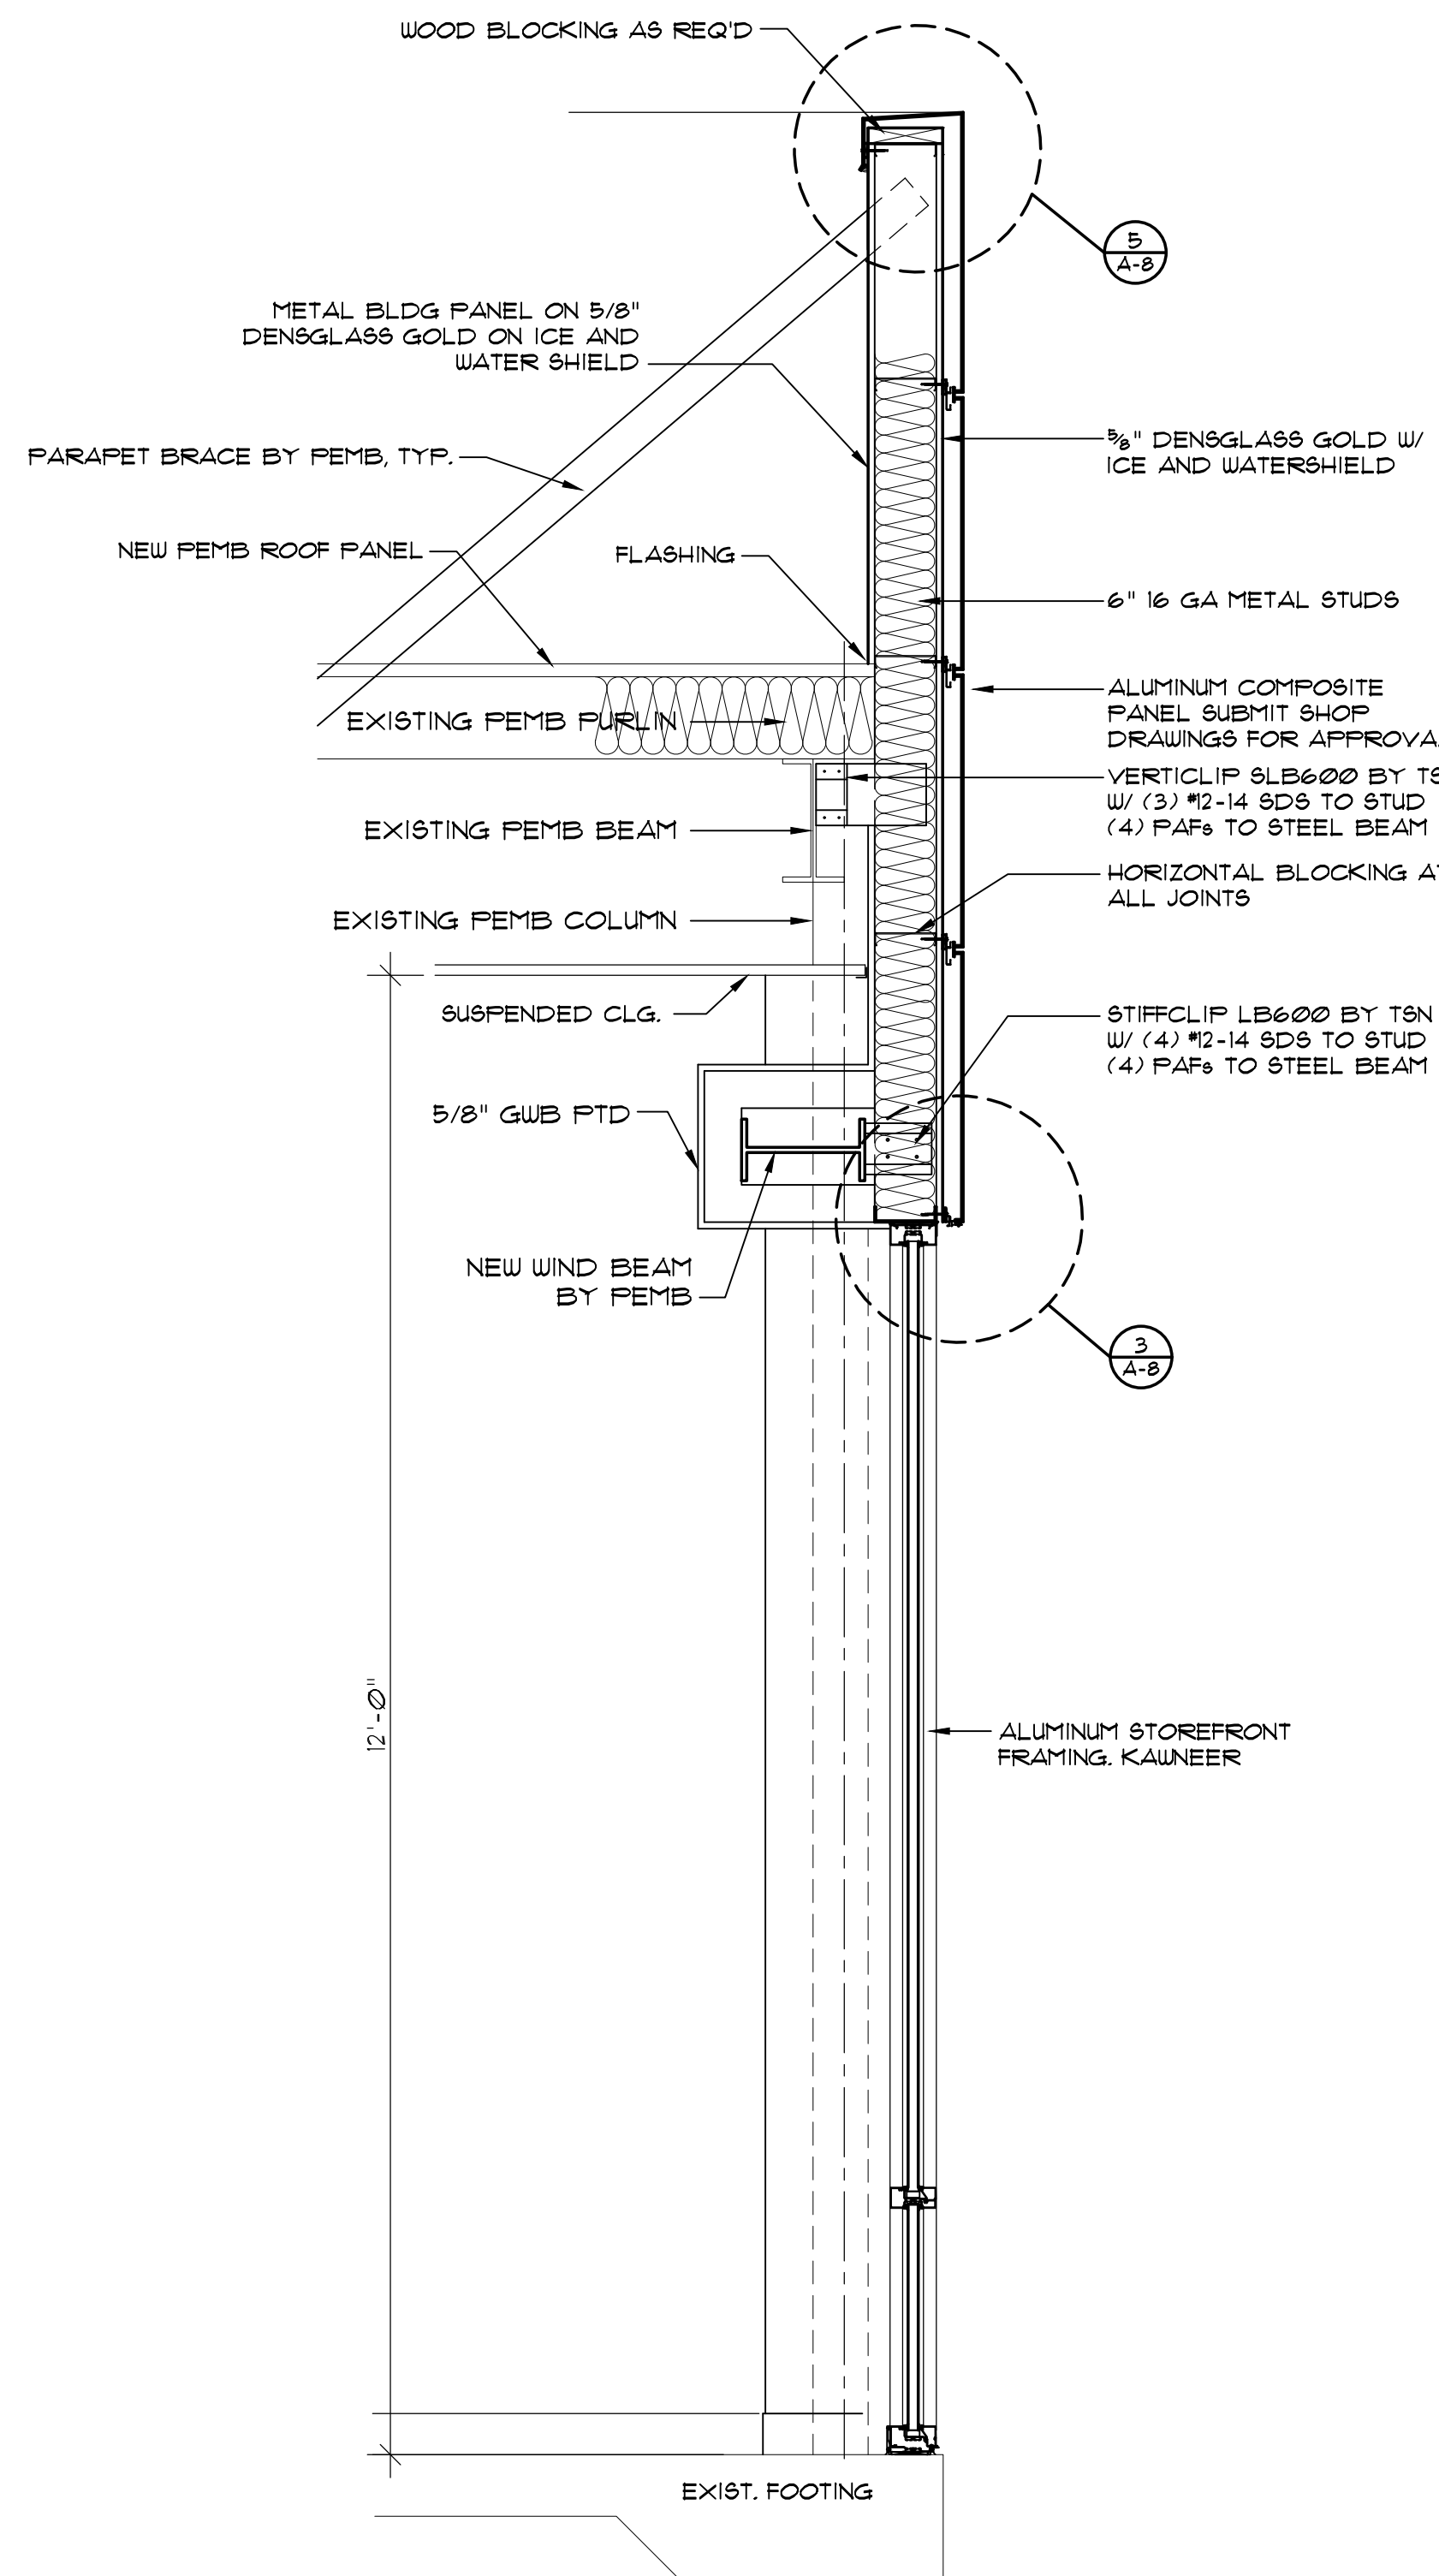


2 SECTION
A-5 SCALE: 3/4"=1'-0"

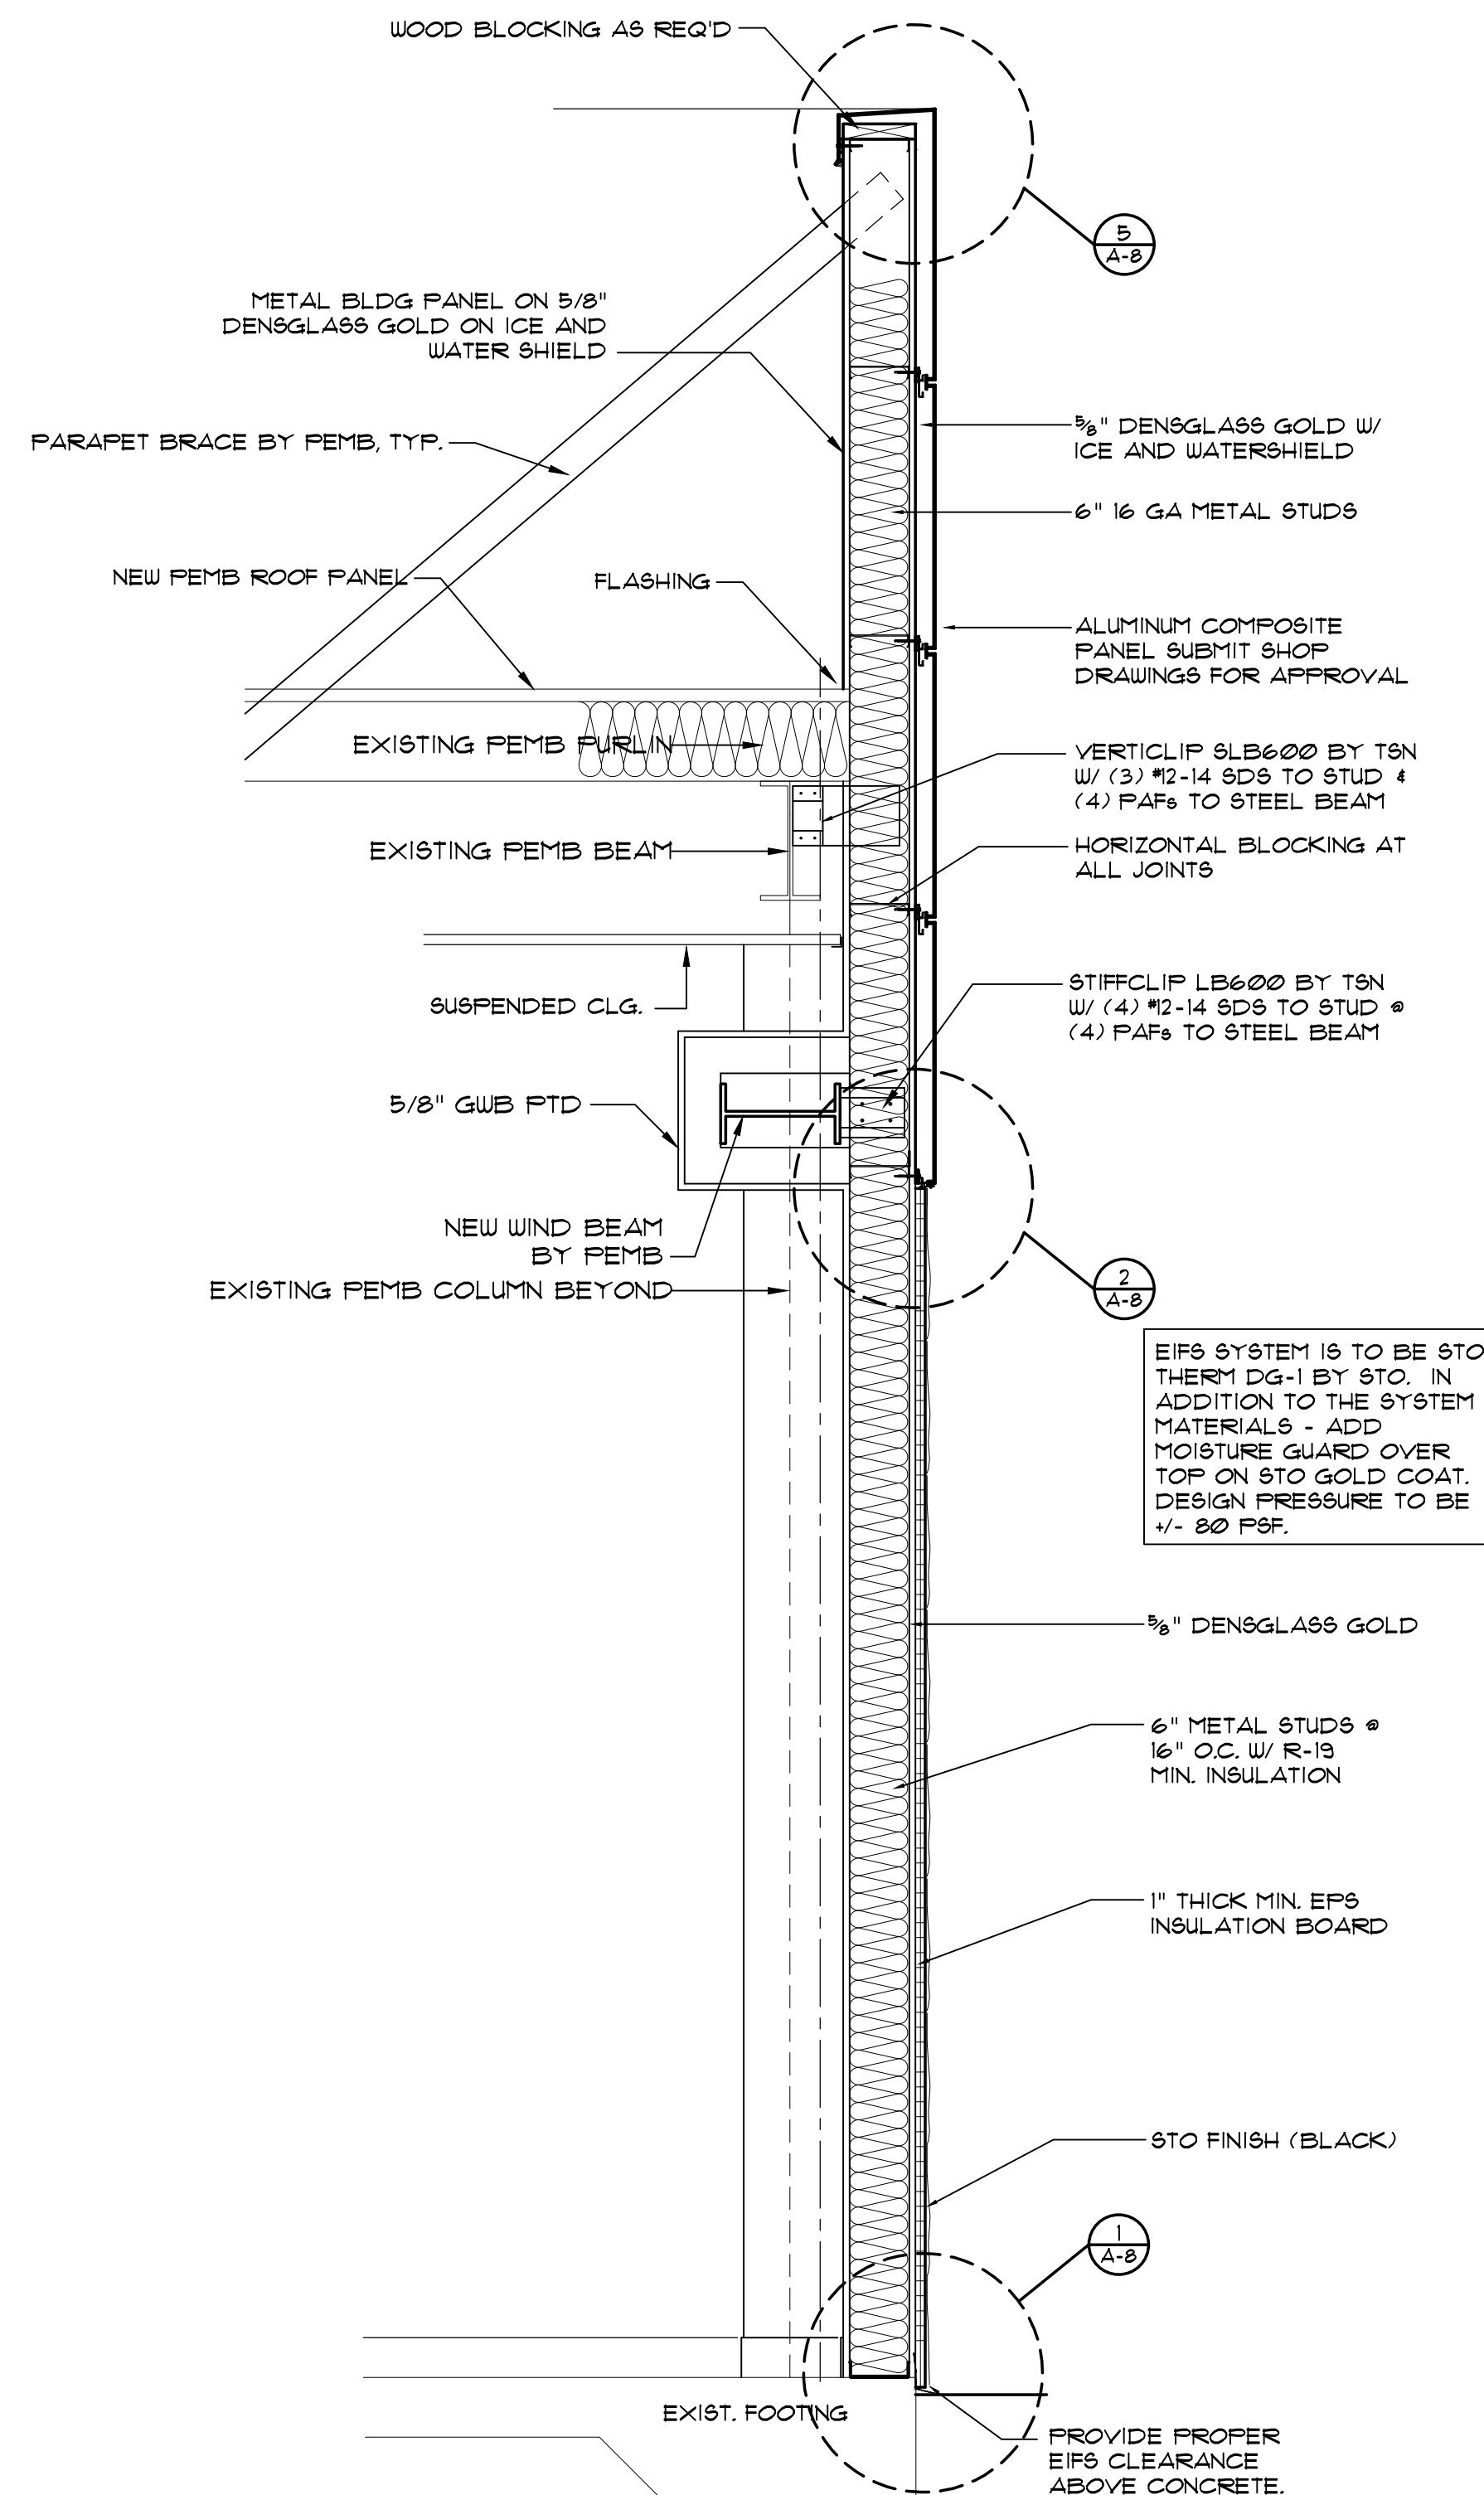

1 SECTION
A-5 SCALE: 3/4"=1'-0"

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA



WALL SECTIONS

17038

ISSUED: 28 NOV 18


DWG BY: LSA

CKD BY: LDD

REVISIONS

SHEET NO.

A-5.1
OF

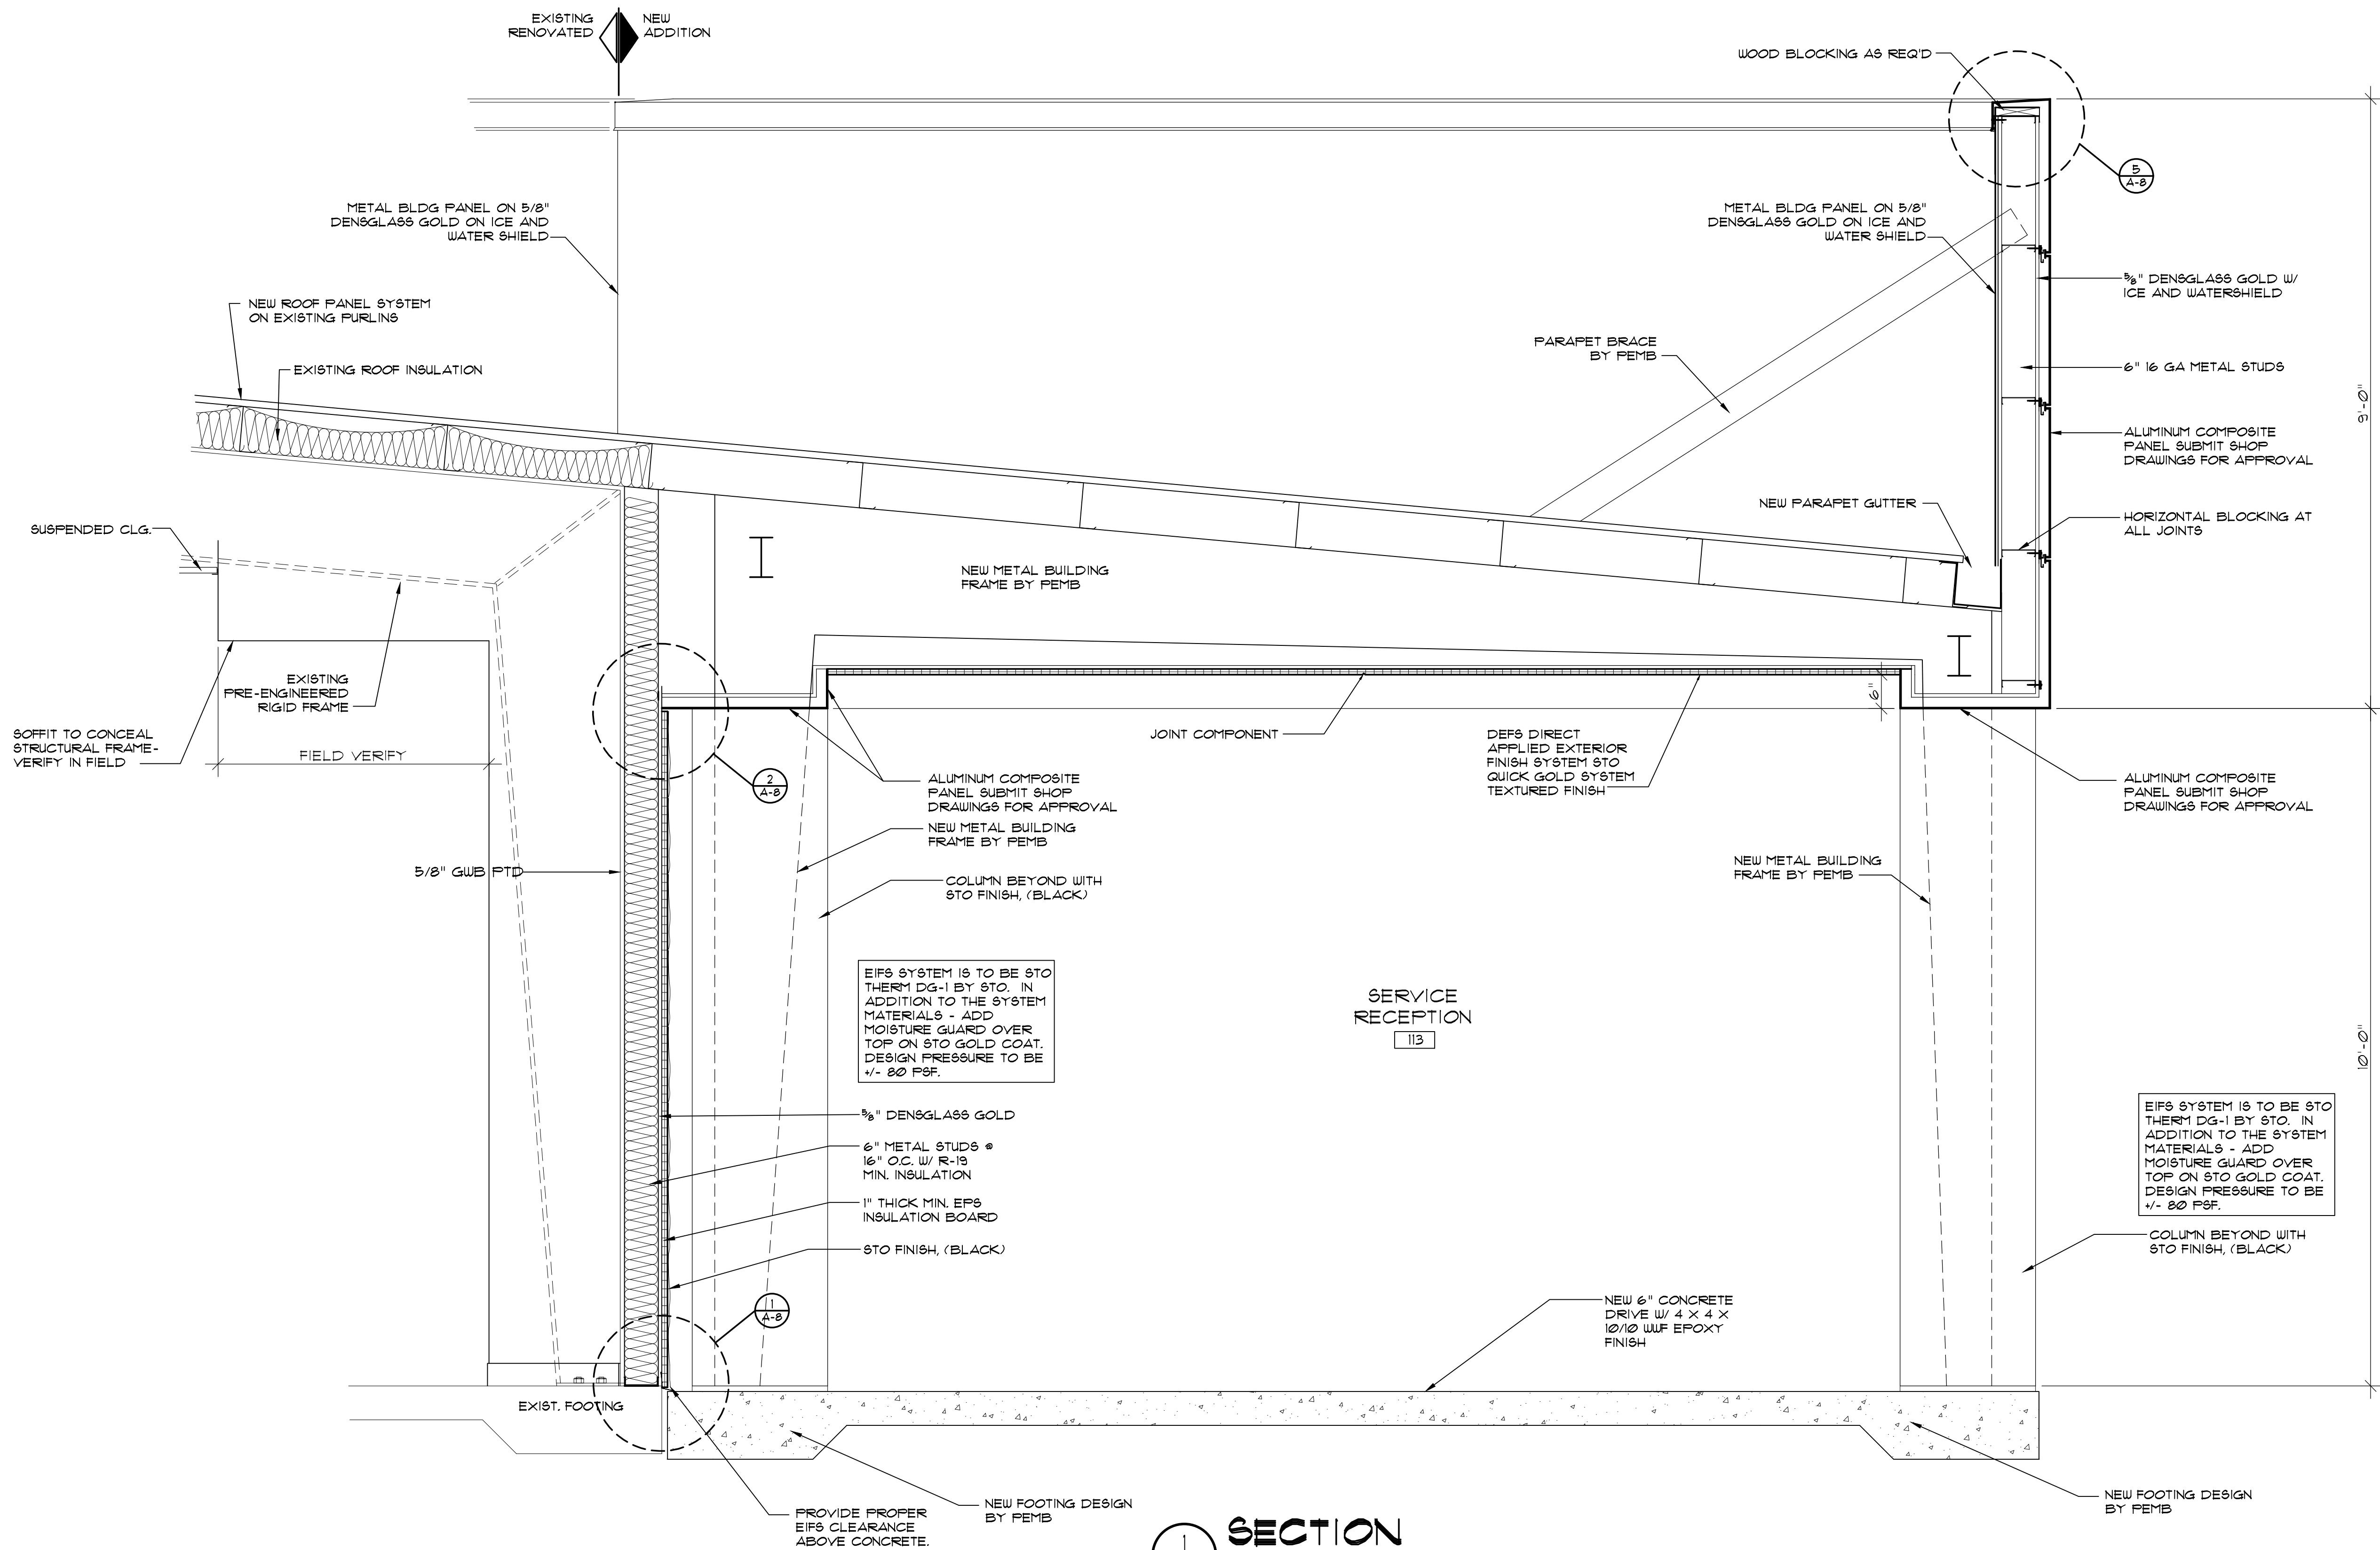


SECTION
A-5.1
SCALE: 3/4" = 1'-0"

ACCESSORY SCHEDULE


Mark	Item	Mtg. Ht.	Remarks
TA-1	FRAMELESS MIRROR 2'W X 3'H (B-165 2436)	3'-4"	HEIGHT TO BOTTOM, CENTER ON SINK
TA-2	TOILET PAPER HOLDER B-4288	1'-10"	HEIGHT TO CENTER OF BOTTOM ROLL
TA-3	NOT USED		
TA-4	HANDICAP SOAP DISPENSER B-5050	3'-6"	HEIGHT TO DISPENSER
TA-5	GRAB BAR 42" CONCEALED MOUNTING W/ SNAP FLANGE	3'-0" MAX.	HEIGHT TO CENTER
TA-6	GRAB BAR 36" CONCEALED MOUNTING W/ SNAP FLANGE	3'-0" MAX.	HEIGHT TO CENTER
TA-7	GRAB BAR 18" CONCEALED MOUNTING (VERTICAL) W/ SNAP FLANGE	3'-3"	HEIGHT TO BOTTOM, CENTER OF BAR @ 40" FROM REAR WALL
TA-8	KOALA KARE CHANGING STATION- SURFACE MOUNTED KB110-SSUM	4'-0"	HEIGHT TO TOP
TA-9	GRAB BAR 24" CONCEALED MOUNTING W/ SNAP FLANGE	33"-36"	HEIGHT FROM FLOOR TO TOP OF GRIPPING SURFACE
FIX-2	LAVATORY- TOTO LT191(G)		FAUCET- 05 GFM LAV FAUCET TEL155-D10ETEL155 - C20ET0CP COLOR/FINISH: *CP POLISHED CHROME
FIX-3	FAUCET- TOTO GOOSENECK ECOPOWER		FAUCET- 05 GFM LAV FAUCET TEL155-D10ETEL155 - C20ET0CP COLOR/FINISH: *CP POLISHED CHROME
FIX-4	HAND DRYER BY DYSON		DYSON AIRBLADE AB-14 COLOR/FINISH: GRAY/SILVER
FIX-5	TOILET BY TOTO		WALL MOUNTED FLUSHOMETER TOILET, 120 GPF WHEN USED WITH HIGH EFFICIENCY FLUSHOMETER VALVE. CT108E (VG) SANAGLOSS CERAMIC GLAZE, COLOR: *01 COTTON. INCLUDE FLUSHOMETER VALVE - ECOPOWER 4 SEAT
FIX-6	URINAL BY TOTO		0.5 GPF LOW CONSUMPTION WASHOUT URINAL, UT104E, 3/4" TOP SPUD INLET, COLOR: *01 COTTON. INCLUDE FLUSH VALVE - ECOPOWER
QS-2	QUARTZ SURFACE DUPONT ZODIAC STORM GREY		
RP-1	RESTROOM PARTITIONS ACCURATE PARTITIONS CORP. POWDER COATED STEEL, PARTITION COLOR: 980 WHITE FLOOR ANCHORED		
PL-4	PLASTIC LAMINATE CABINETS WILSONART 48T1-38 GREY MESH FINE VELVET TEXTURE FINISH		

NOTES:


- MODEL NUMBERS ARE BOBRICK UON BRADLEY & FRANKLIN ARE APPROVED EQUALS, SUBMIT CUT SHEETS FOR APPROVAL.
- ALL HANDRAILS SHALL BE BLOCKED TO SUPPORT A 250 LB. LOAD MINIMUM

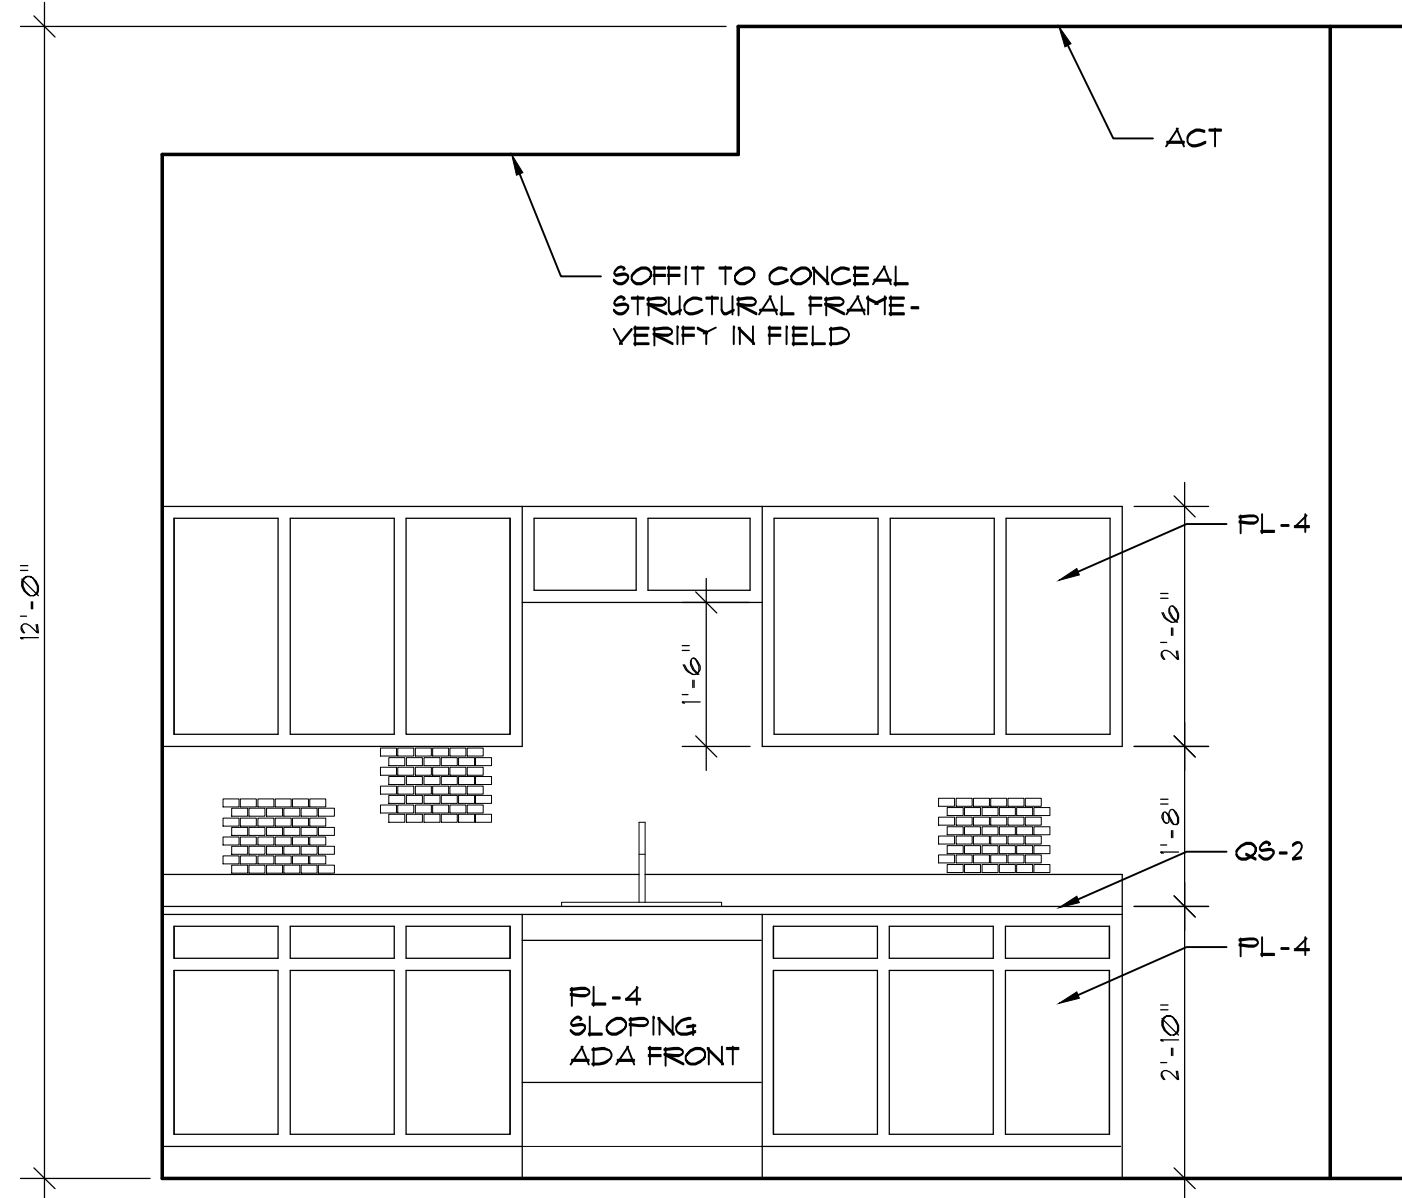


5 CUSTOMER LOUNGE 107
SCALE: 1/2" = 1'-0"

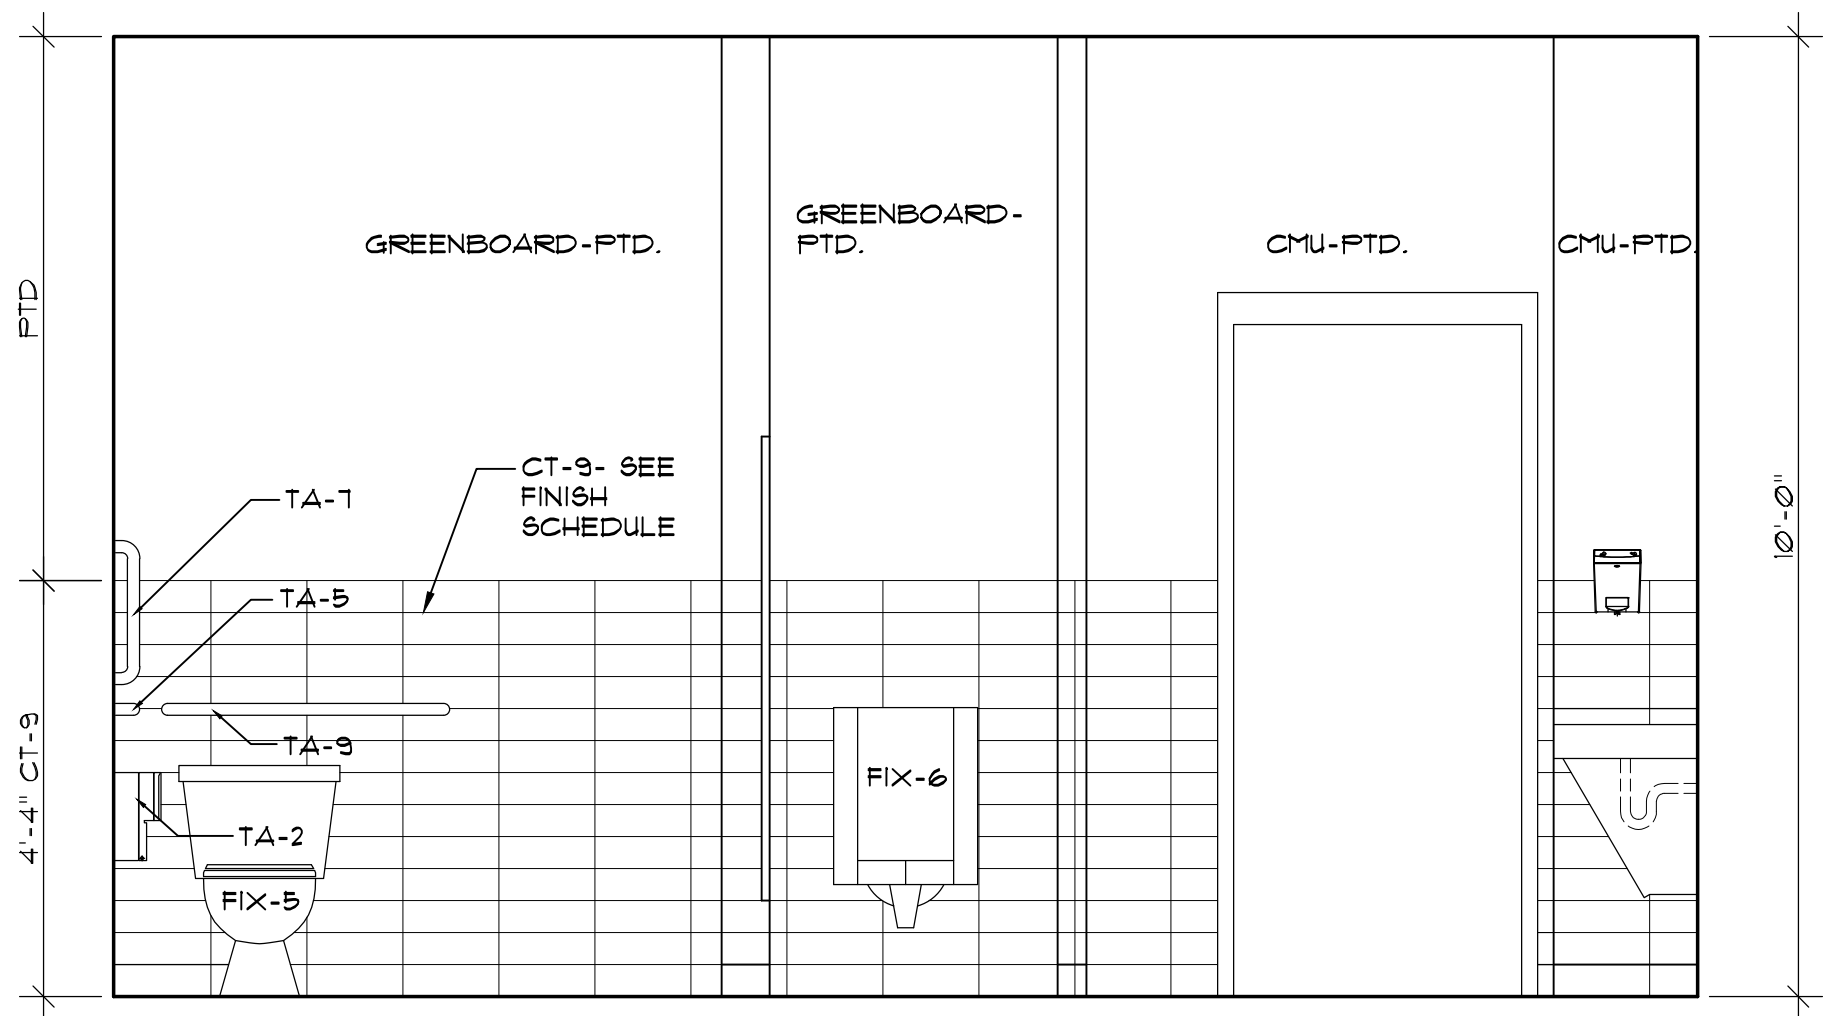


4 TECH TOILET 110
SCALE: 1/2" = 1'-0"

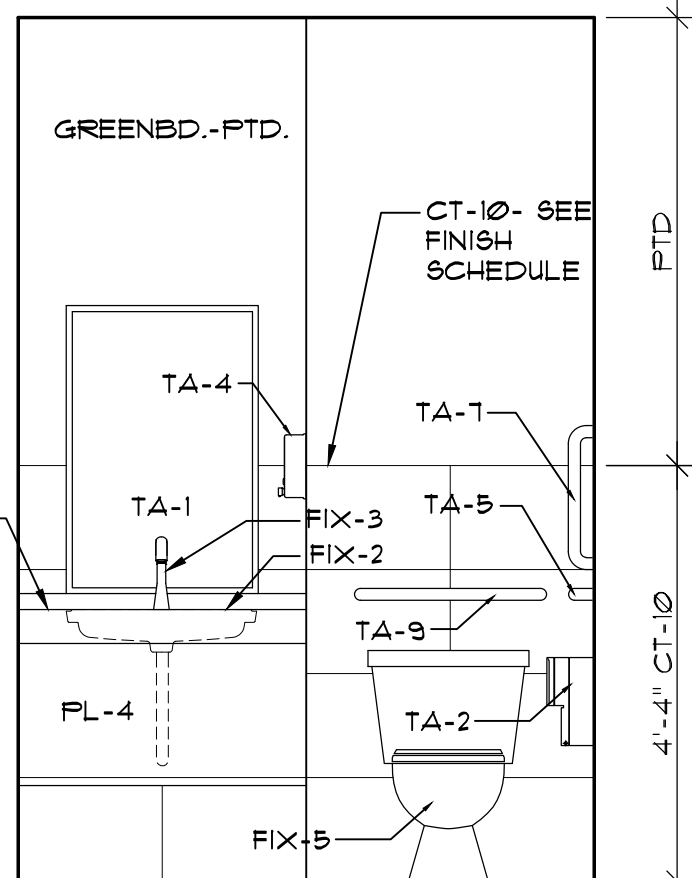


3 MEN 108 / WOMEN 109
SCALE: 1/2" = 1'-0"

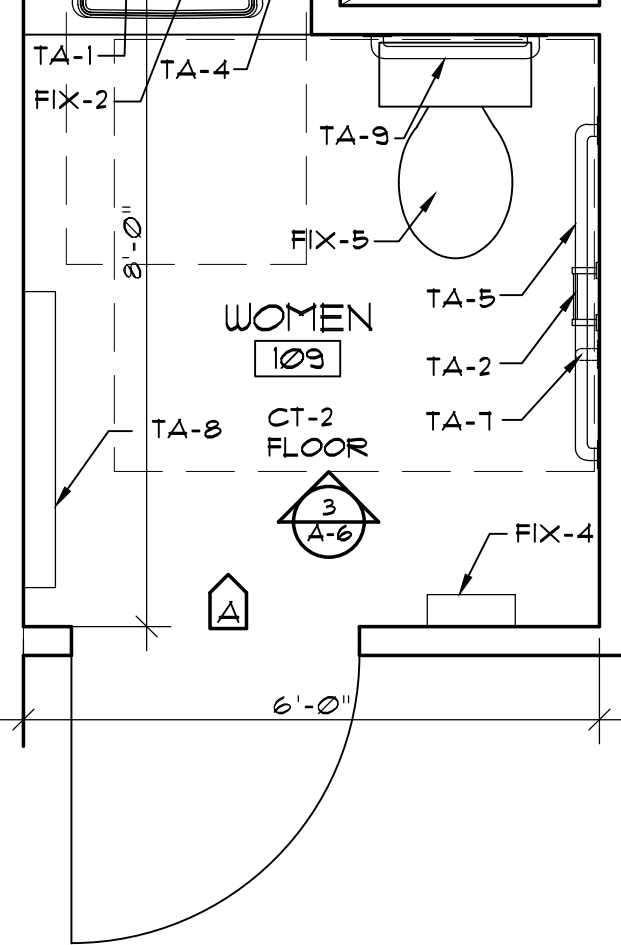


2 WOMEN 109/TECH TOILET 110
SCALE: 1/2" = 1'-0"

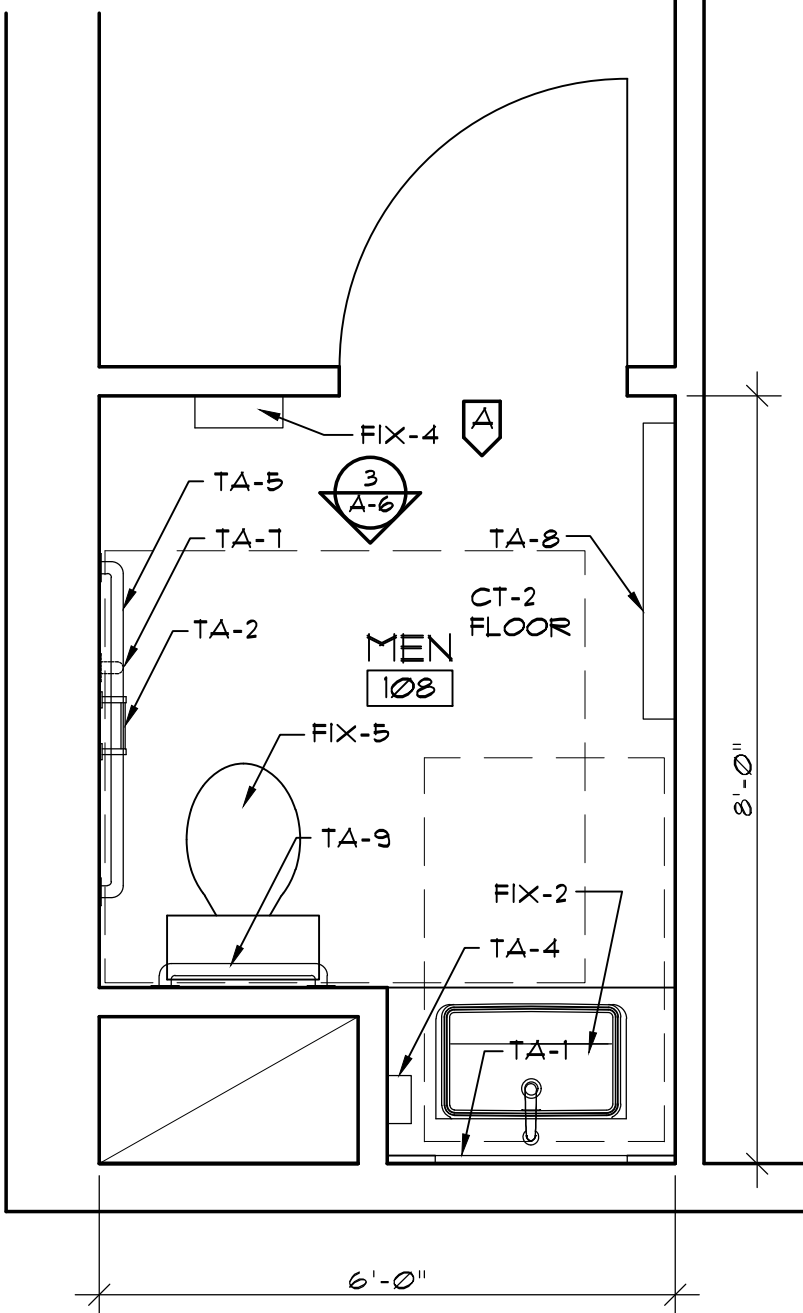


1 MEN 108
SCALE: 1/2" = 1'-0"

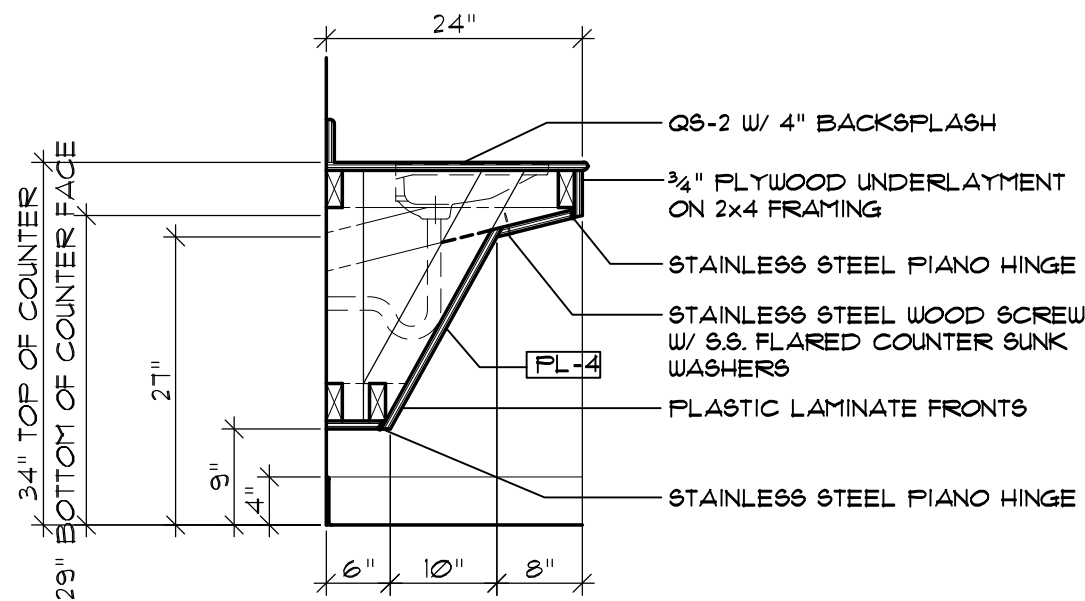

7 H.C. VANITY DETAIL
SCALE: 3/4" = 1'-0"

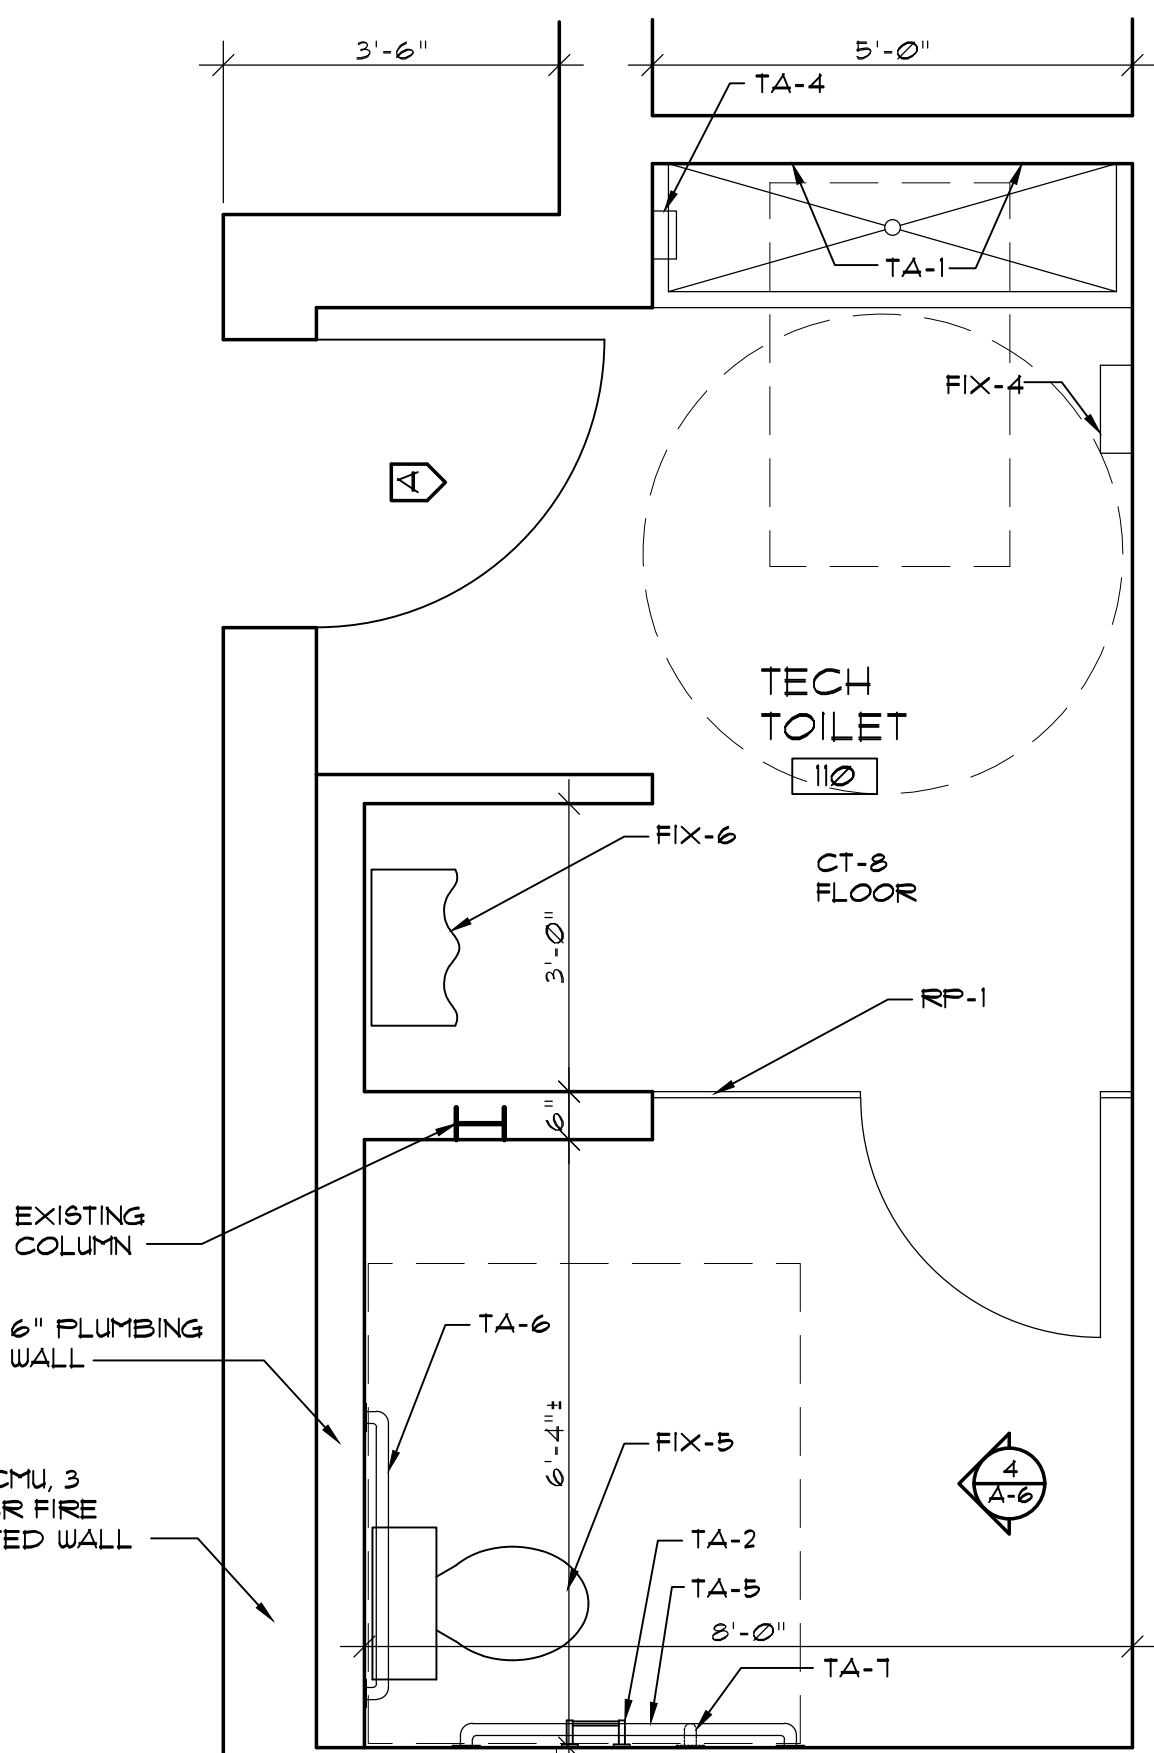

- GENERAL NOTES:
- PLASTIC LAMINATE EXTERIOR
 - INTERIOR - MELAMINE
 - CONCEALED HINGES THROUGHOUT
 - 6" SATIN NICKEL FULLS
 - ALL SHELVING ADJUSTABLE, W/ COUNTERSUNK STANDARDS.

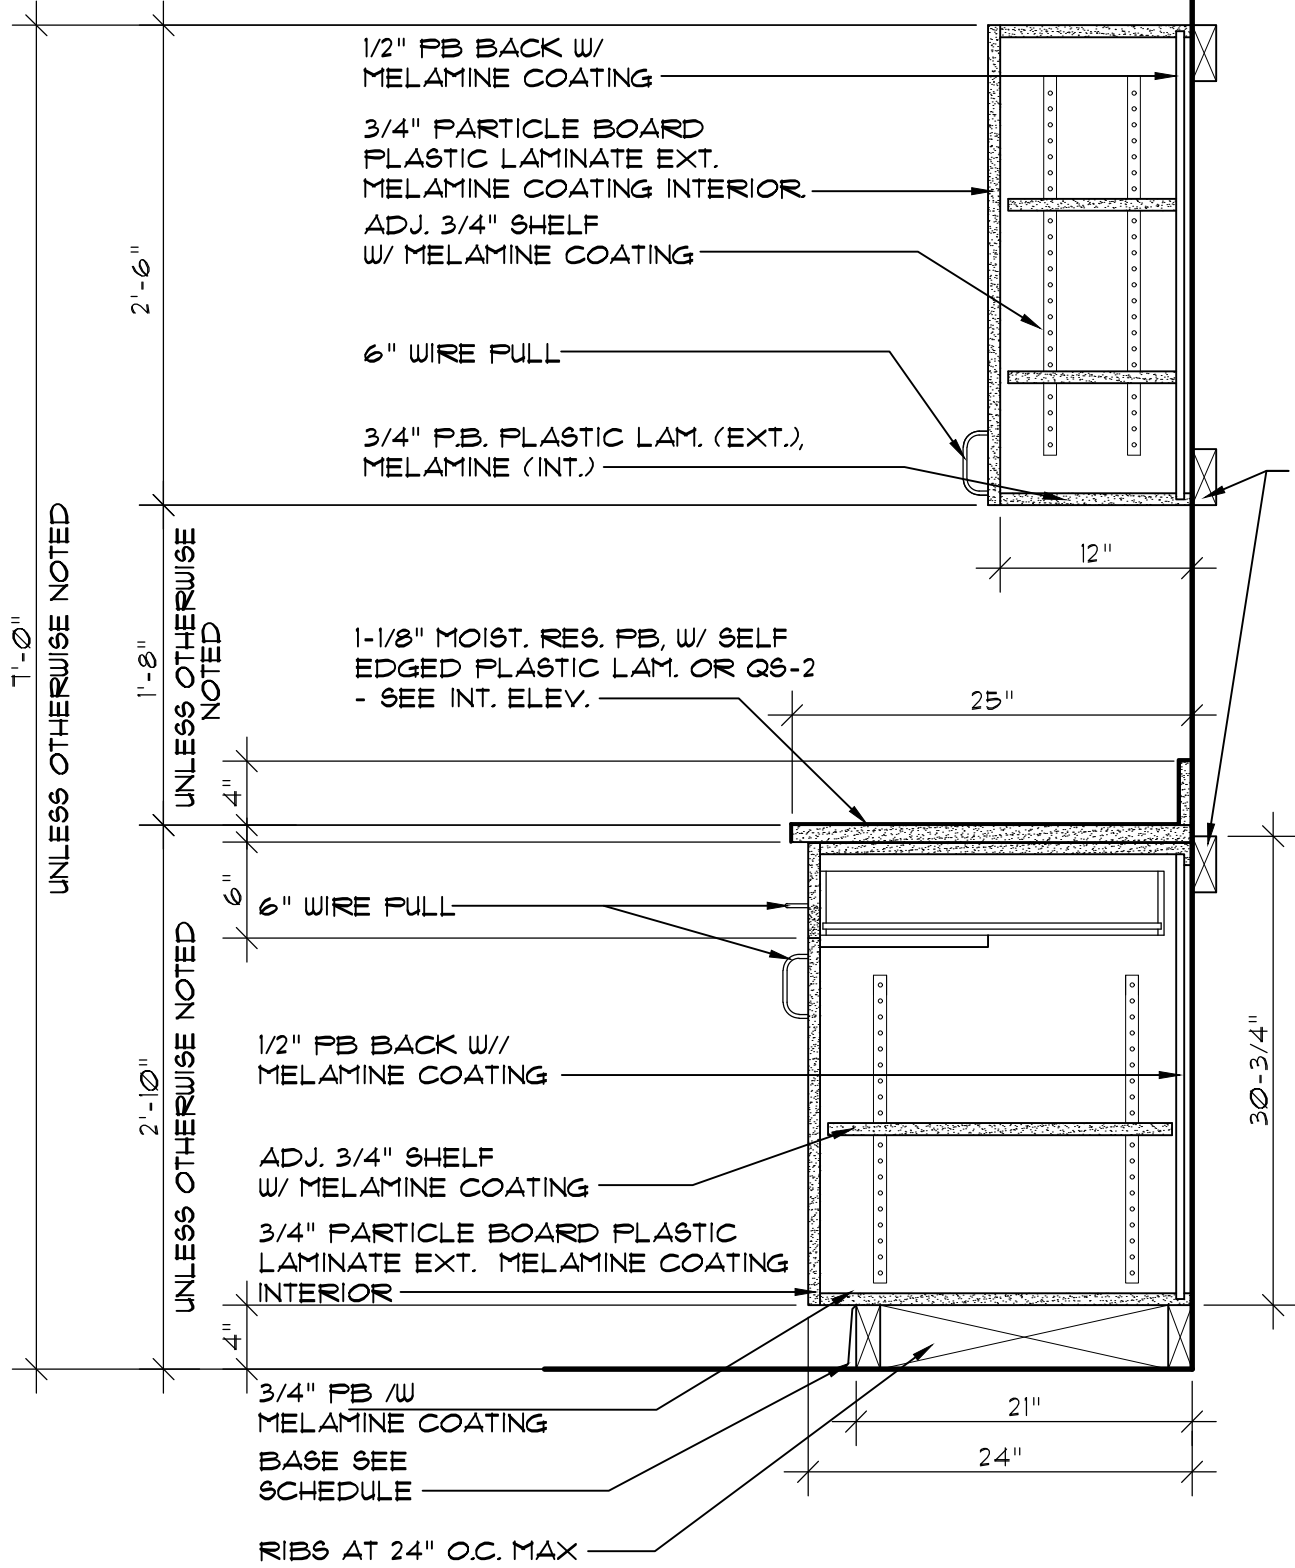

6 TYP. CABINET DETAIL
SCALE: 1/2" = 1'-0"

Coastal Architecture

• Architectural Design
• Planning
• Interiors


AIA

Member of the American Institute of Architects

Lee D. Dixon, Jr., AIA
252-247-2127
lee@coastalarchitecture.net

4206 Bridges St. Ext., Suite C
Morehead City, NC 28557
www.CoastalArchitecture.net

MAZDA OF NEW BERN
NEW BERN, NORTH CAROLINA

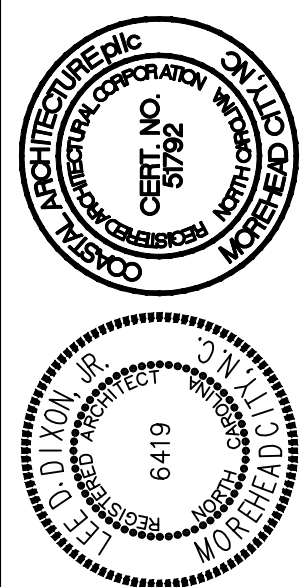

ENLARGED PLANS
INTERIOR ELEVATIONS

17038

ISSUED: 28 NOV 18
DWG BY: LSA, MES
CKD BY: LDD

REVISIONS

SHEET NO.
A-6
OF

CMU LINTEL SCHEDULE			
MAX. OPENING	BLOCK SIZE	LINTEL DEPTH	REINFORCING
≤ 6'-4"	8"	16"	(2)-#5 CONT.
≤ 4'-0"	8"	8"	(2)-#5 CONT.

NOTES:
1. CMU LINTELS ARE PERMITTED AT INTERIOR NON-LOAD BEARING WALLS ONLY - ALL OTHER WALLS ARE TO USE STEEL LINTELS AS DETAILED.
2. LINTEL DESIGN ASSUMES ARCHING ACTION OF BLOCK. NO WALL PENETRATIONS ARE PERMITTED WITHIN SPAN/2 OR 24" (WHICH EVER IS GREATER), MEASURED FROM TOP OF LINTEL. SHOULD PENETRATIONS BE REQUIRED WITHIN THIS AREA, A STEEL LINTEL BEAM IS TO BE SUBSTITUTED PER THE PROVIDED DETAILS.
3. CMU LINTEL BEAMS ARE TO BEAR 8" (MIN.) ON EITHER SIDE OF OPENING. HORIZONTAL REINFORCING IS TO BE CONTINUOUS OVER THE FULL SPAN + BEARING.
4. SEE DETAILS FOR TYPICAL JAMB REINFORCING.
5. REFER TO GENERAL REINFORCING NOTES FOR ADDT'L. WALL CONSTRUCTION DETAILS.

TYPICAL WALL REINFORCING AS REQ'D.
GROUT SOLID OVER FULL LINTEL SPAN + BEARING
REINFORCING SEE SCHEDULE.
TYPICAL CMU LINTEL
LINTEL DEPTH 'TYP. WALL' ABOVE
SEE SCHED.


7 MASONRY LINTEL SCHEDULE
A-8 SCALE: N.T.S.

CMU WALL REINFORCING SCHEDULE			
APPLICATION / MARK	BLOCK SIZE	REINFORCING	NOTES
TYP. EXTERIOR WALLS	8"	#5 @ 48oc.	-
TYP. INTERIOR WALLS	8"	#5 @ 48oc.	-
MEZZANINE BEARING WALLS	12"	(2) #5 @ 48oc.	GROUT ALL CELLS SOLID
FIRE SEPARATION WALL	12"	(2) #5 @ 48oc.	GROUT ALL CELLS SOLID


REINFORCING NOTES:
1. SEE GENERAL NOTES FOR ALL MATERIAL SPECIFICATIONS.
2. MASONRY SHALL BE LAID IN RUNNING BOND UNLESS NOTED OTHERWISE.
3. LAP SPLICES SHALL BE A MINIMUM OF 48 BAR DIAMETERS, U.N.O.
4. PROVIDE DUR-O-WALL (OR EQUAL) LADDER OR TRUSS TYPE HORIZONTAL JOINT REINFORCEMENT AT EACH SECOND COURSE IN RUNNING BOND, AND AT EACH COURSE IN STACKED BOND, UNLESS NOTED OTHERWISE.
5. MASONRY BOND BEAMS REINFORCED WITH (2)-#5 BARS ARE TO BE PROVIDED EVERY 6'-0" OF VERTICAL WALL, AT TOPS OF ALL MASONRY WALLS, AND WHERE SHOWN ON DRAWINGS. FIRST BOND BEAM MAY BE PLACED AT TOP OF DOOR OPENINGS, 8'-0" MAX. AT BOND BEAM CORNERS AND TEE JOINTS, PROVIDE BENT BARS TO MATCH QUANTITY AND BAR SIZE IN THE BOND BEAM. REINFORCING LAP SPLICES W/IN BOND BEAMS SHALL BE 48 BAR DIAMETERS OR A MINIMUM OF 2'-0", WHICHEVER IS GREATER.
6. ALL MASONRY CELLS RECIEVING REINFORCING ARE TO BE GROUTED SOLID UNLESS NOTED OTHERWISE.
7. SEE PLANS FOR ADDITIONAL REINFORCING REQUIREMENTS AT SUPPORTS, TERMINATIONS, AND WALL INTERSECTIONS.

TYPICAL 12" CMU
TYPICAL 8" CMU
GROUT SOLID AT ALL REINFORCED CELLS U.N.O. (TYP.)


6 TYP. MASONRY REINFORCING SCHEDULE
A-8 SCALE: N.T.S.

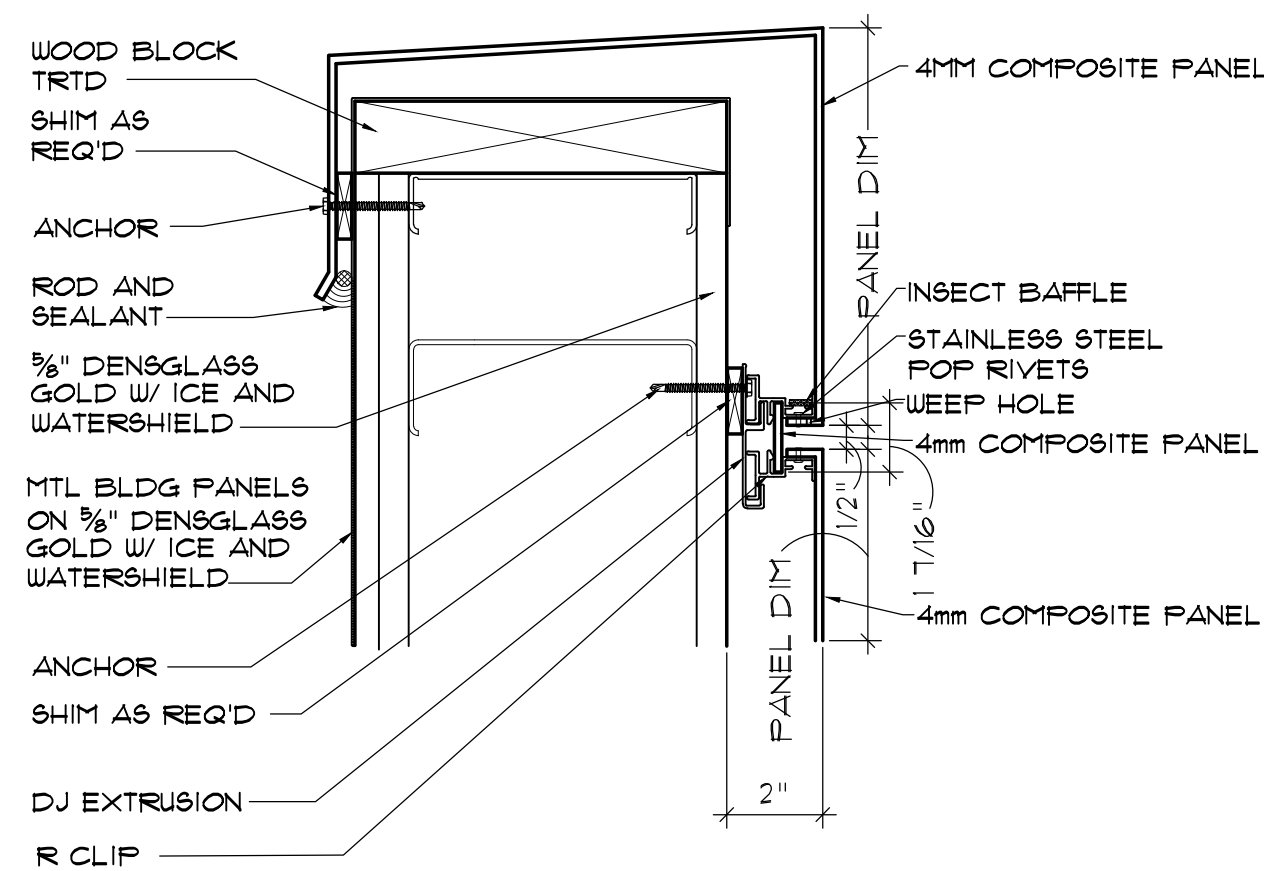


5 DETAIL @ TOP
OF PARAPET
A-8 SCALE: 3"=1'-0"

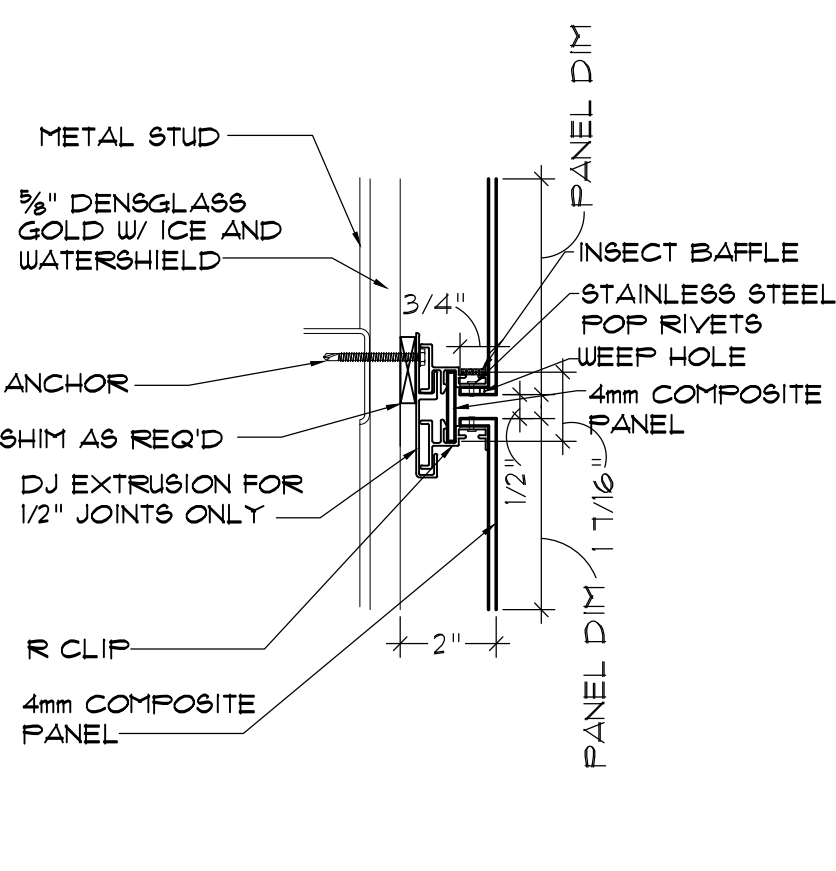


4 DETAIL @ ACM JOINT
A-8 SCALE: 3"=1'-0"

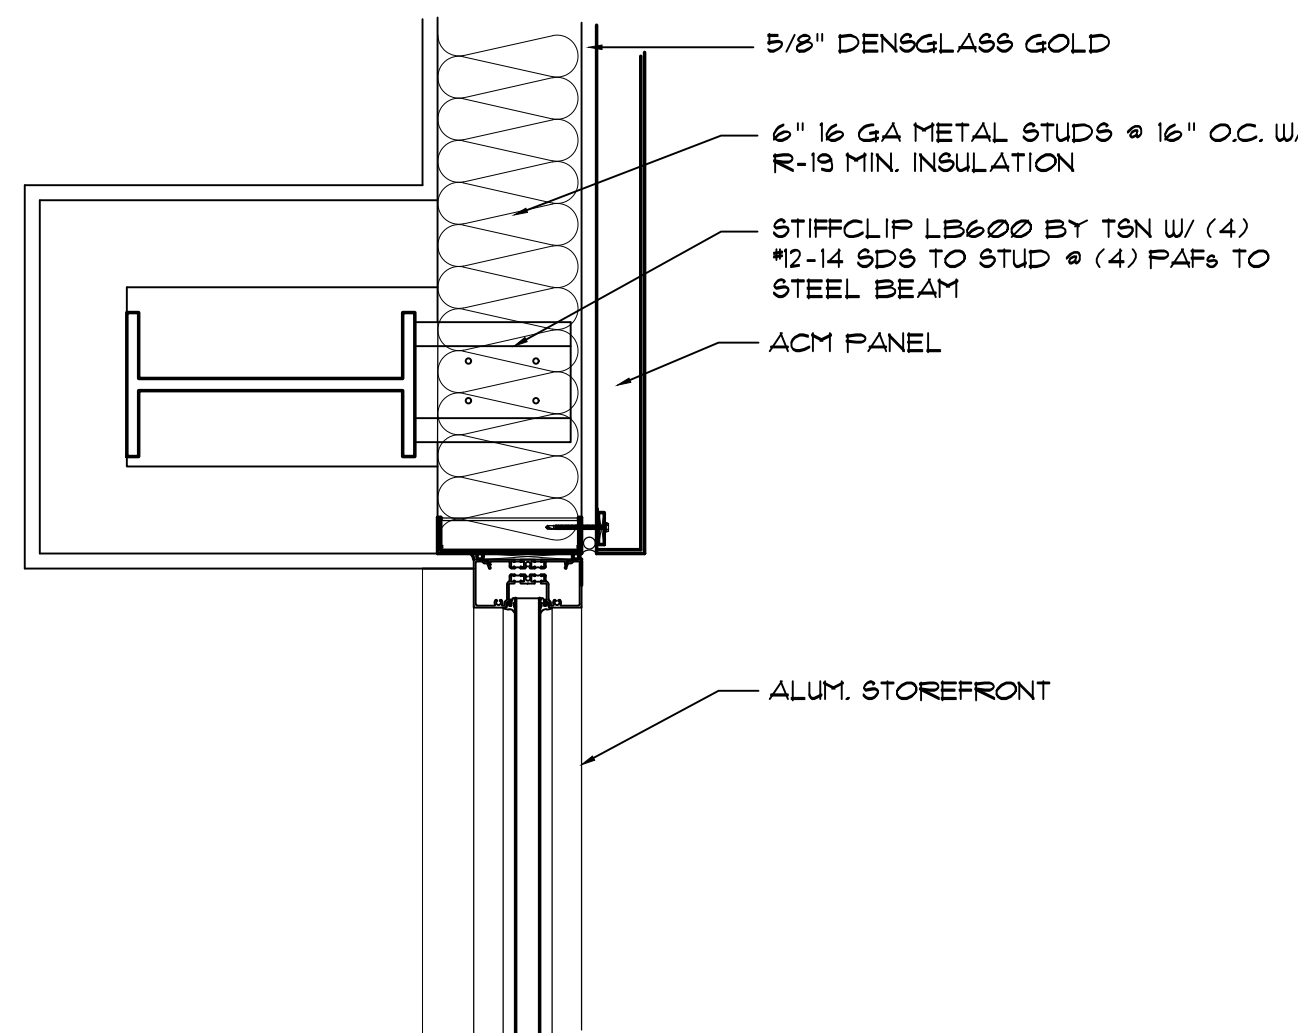

3 DETAIL @ ACM AND
STOREFRONT
A-8 SCALE: 1 1/2"=1'-0"

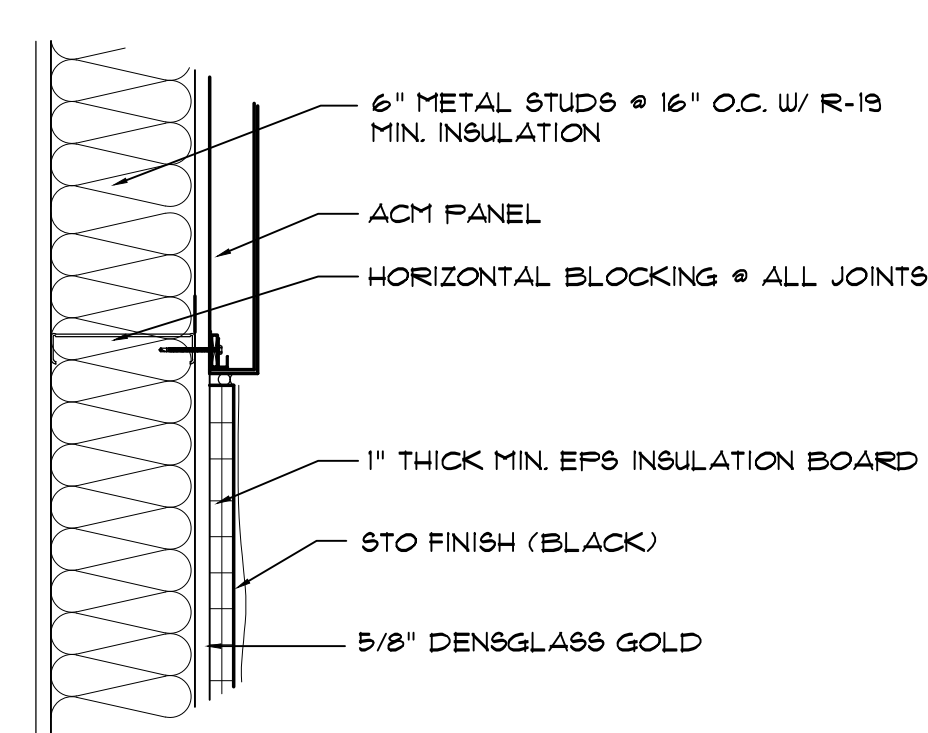

2 DETAIL @ EIFS AND
ACM TRANSITIONAL
A-8 SCALE: 1 1/2"=1'-0"

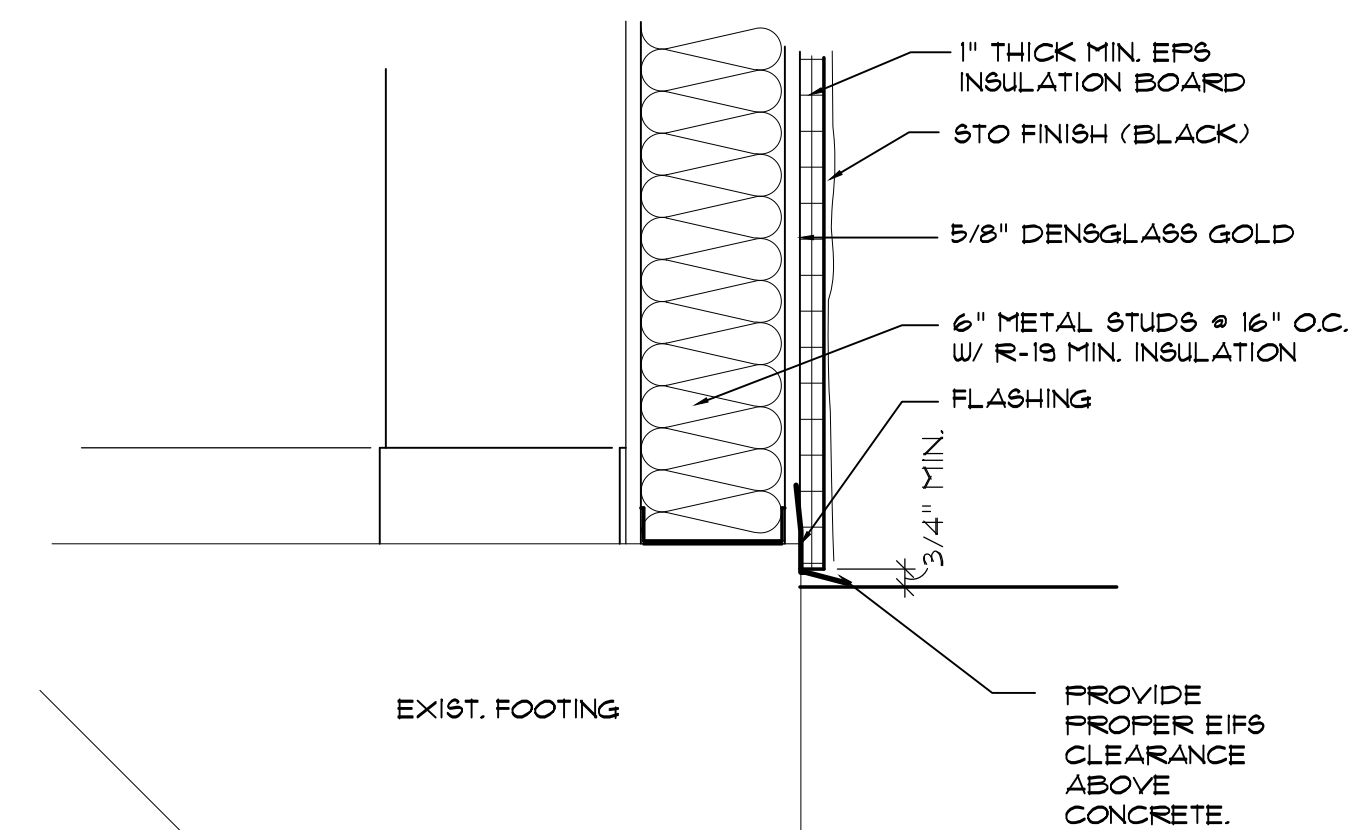

1 DETAIL @ EIFS AND CONCRETE
A-8 SCALE: 1 1/2"=1'-0"